



SF5 TYPE: FRONT ELEVATION: SCALE 1:100

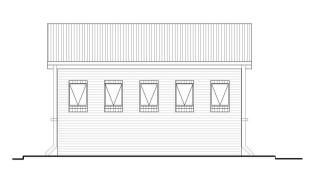

SF5 TYPE:


## BACK ELEVATION:

**SCALE 1:100** 




SF5 TYPE: SIDE ELEVATION:

**SCALE 1:100** 

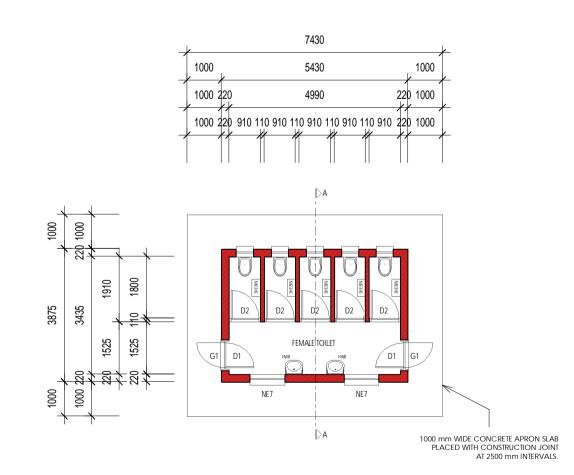

SF5 TYPE:

FLOOR PLAN: **SCALE 1:100** 

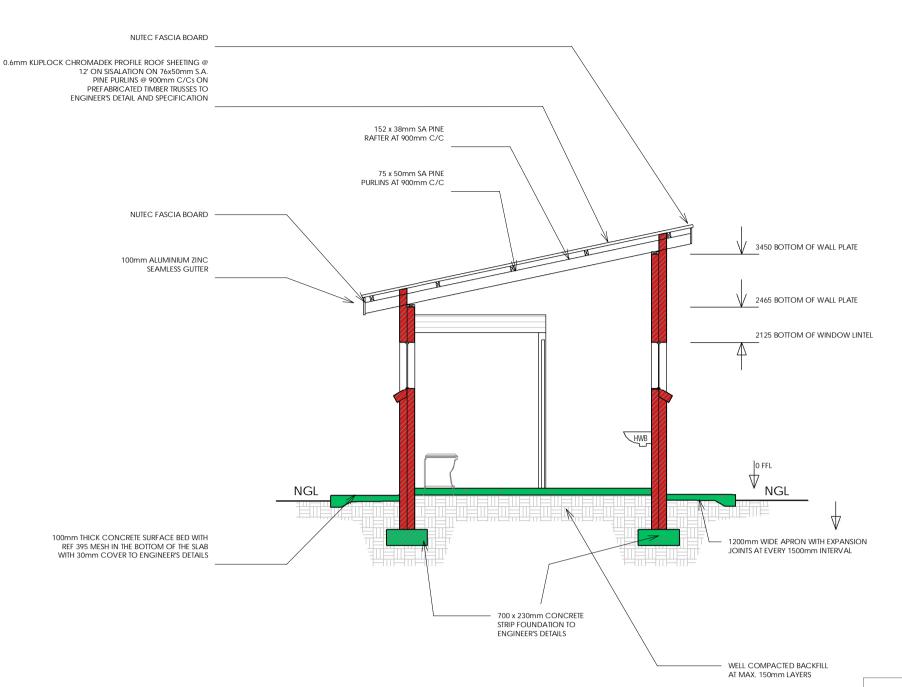

SF5 TYPE:


**SECTION A-A: SCALE 1:50** 



SF5 TYPE:

## SIDE ELEVATION:

**SCALE 1:100** 



SF5 TYPE:

## FOUNDATION PLAN: SCALE 1:100



**BUGLAR DOOR** 

813

EXTERNAL TOILET BLOCK

PURPOSE MADE SQUARE HOLLOW SECTION

1xCOAT ZINC CHROMATE PRIMER MINIMUM 2 x COATS GLOSS ENAMEL (EXTERNAL QUALITY)

50x38x1.6mm M.S. RECTANGULAR HOLLOW SECTION FRAME

1xCOAT 7INC CHROMATE PRIMER MINIMUM

38x28x1.6mm RECTANGULAR HOLLOW SECTION

FRAME WITH 25x25x1.6 INTERMEDIATES AT 100n CENTERS AT A 45° ANGLE COLOUR TBC

SECURITY DOUBLE THROW DEAD LOCK (NO LATCH)

2 x COATS GLOSS ENAMEL (EXTERIOR

2 OFF:

## **GENERAL NOTES AND SPECIFICATIONS:**

TYPE G1:

POSITION:

DOOR TYPE

FRAME:

DOOR:

DOOR FINISH:

FRAME FINISH:

Use dimensions provided and do not scale drawing.

All work to comply with SANS, PW371 and SABS. All dimensions, levels and positions to be verified on site prior to

construction. All concrete work to be as per Engineer's details and

specifications. All pits to face North.

All brickwork have brickforce at every 2nd course in pit lining and 3rd course in superstructure.

PIT EXCAVATION

All stages of pit excavation to be inspected and approved by Engineer and signed off.

2. All pit lining to be inspected by EnviroLoo Services before slab

COMPACTION OF SURFACES

All ground surfaces receiving concrete floors / slab should be compacted to 150mm layers 93% ModAASHTO density before casting concrete.

CONCRETE WORKS

All concrete to be as per Engineer's details and specifications. 25 MPa strength concrete to be used throughout construction: Trial Concrete Mixes: Proportions Concrete Strenght at 28 Days 25Mpa: 1:2:2 (mix proportion by volume) 1 bag cement: 0.08m3 Sand: 0.09m3 Stone (Volume/Bag) 385 kg cement : 820 kg sand : 960 kg stone (Mass/m3)

Pre-cast concrete lintols to be used as support under top slab of pit.

All concrete aprons to be 1000mm wide. MORTAR Mixed proportions to be: 1 cement : 3 sand (i.e.1 bag cement : 3 wheelbarrows (37 litres) sand)

BRICKWORK Sub-structure

All pit lining / foundation brickwork to be solid NFP clay brick. 2. All internal surface of pit lining to be painted with two coats black expoxy paint installing Enviro-Loo units.

Super-structure All external walls / partitions to be of clay face brick to SABS quality.

All cubicle partition walls to be 3 courses above door height. All brickwork above door openings should have brickforce on every

course at least 3 courses. 4. Air bricks: Standard 230X152mm terra-colts vermin proofed lourved air grating to be used above all window openings.

1. 0.6mm kliplock chromadek roof sheeting.

ROOF TIMBER / CEILING

1. All roof timbers to be machined SABS treated wood with three coats of approved wood preservative.

2. Timber connections (Hurricane Clips) are required all

intercessions between timber rafters and purlins. 3. Sisalation is to be applied interval under all roof surfaces.

METALWORK

1. All metalwork should be primed before installation. 2. All steel window should have 6x20mm flat bar burglar proofing.

PLUMBING

Double concrete wash trough to be used.

All wash troughs should be connected to the school's water supply system and the waste water should be piped to a soakaway. The soakaway should be as per Engineer's detail and position to be


determined on site.


4. Only 20mm and galvanised pipework should be used as connection from wall to the discharge points.


GLAZING

6.28mm obscure safety glass 2. Stainless steel mirrors size 350x450mm high.


1. All paintwork to comply with SABS and PW371 specification. All steel window and door frames including doors and fascia / barge boards to be discharge points.

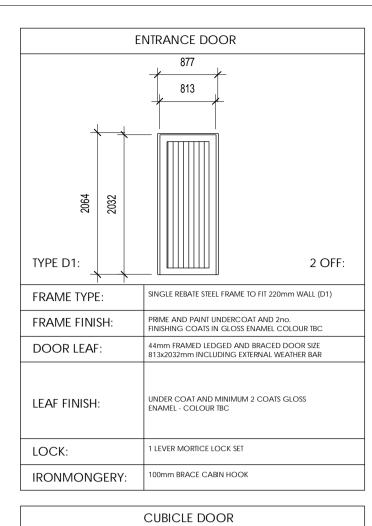

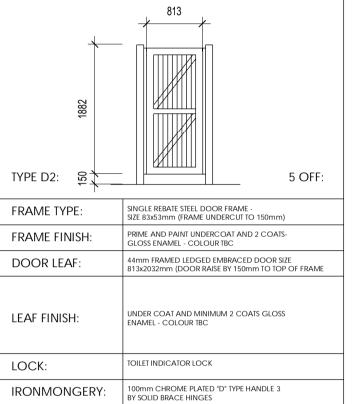


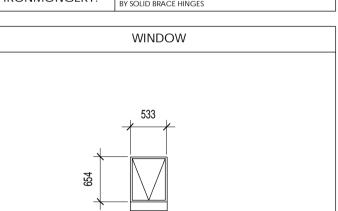

N1
NE1
533 x 654mm HIGH STANDARD STEEL WINDOW FRAME
SPOT PRINING DEFECTS IN PRE-PRIME SURFACE WITH ZINC CHROMATE PRIMER & APPLY ONE UNIVERSAL UNDER COAT & TWO COATS EPWP GOLDEN BROWN GLOSS ENAMEL PAINT ON STEEL
6.28mm OBSCURE SAFETY GLASS
5

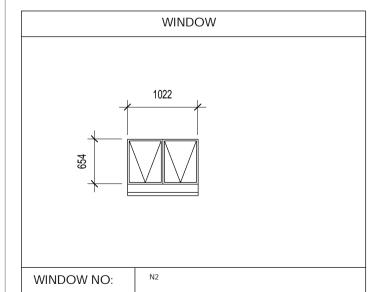

WINDOW NO:	N2
CATALOGUE:	NE7
FRAME:	1022 x 654mm HIGH STANDARD STEEL WINDOW FRAME
FRAME FINISH:	SPOT PRINING DEFECTS IN PRE-PRIME SURFACE WITH ZINC CHROMATE PRIMER & APPLY ONE UNIVERSAL UNDER COAT & TWO COATS EPWP GOLDEN BROWN GLOSS ENAMEL PAINT ON STEEL
GLAZING:	6.28mm OBSCURE SAFETY GLASS
NO REQUIRED:	2

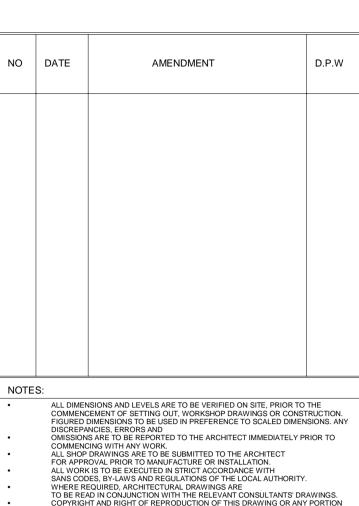

OMISSIONS ARE TO BE REPORTED TO THE ARCHITECT IMMEDIATELY PRIOR TO COMMENCING WITH ANY WORK.
ALL SHOP DRAWINGS ARE TO BE SUBMITTED TO THE ARCHITECT FOR APPROVAL PRIOR TO MANUFACTURE OR INSTALLATION.
ALL WORK IS TO BE EXECUTED IN STRICT ACCORDANCE WITH SANS CODES, BY-LAWS AND REGULATIONS OF THE LOCAL AUTHORITY.
WHERE REQUIRED, ARCHITECTURAL DRAWINGS ARE TO BE READ IN CONJUNCTION WITH THE RELEVANT CONSULTANTS' DRAWINGS. COPYRIGHT AND RIGHT OF REPRODUCTION OF THIS DRAWING OR ANY PORTION THEREOF, IS RESERVED AND REMAINS WITH CDA.
ALL CONSTRUCTION WORK MUST COMPLY WITH THE LAWS OF THE LAND, SANS 10400, THE NATIONAL BUILDING STANDARDS AND LOCAL AUTHORITY BY LAWS AND MODEL PREAMBLES.

KEYPLAN:



**DEPARTMENT OF PUBLIC WORKS** 

**COPYRIGHT VESTS IN THE** 

DWG FILE NAME:



TEL: 082 215 5937 BENDOR 0699 CONSULTANT/DEPARTMENTAL

DIATHO CONSULTING (PTY) LTD OFFICE NO: 2, IT PARK 15 PIERRE STREET BENDOR 0699 TEL : 087 510 5242 CELL: 064 526 9369 FAX : 086 415 6426 Diatho Consulting (PTY) LTD

CONTRACTOR:

LOGO: WCS NUMBER:

TSHILWAVISUKU PRIMARY SCHOOL

LIMPOPO PROVINCE

DRAWING TITLE: **WATER-BORNE ABLUTIONS:** 

REF NO:	TMT-LDOE-2023/24- LPCL23/02C	DRAWN BY: K.M
SCALE:	1:100	CHECKED BY: K.M
DATE:	09.2023	VERIFIED BY: K.M
TYPE NU	MBER: SF5	

W100:SF5