




M4 + 3UR TYPE: FRONT ELEVATION: **SCALE 1:100**

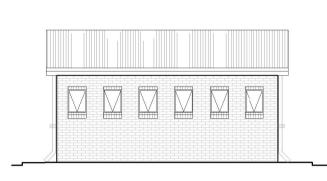

M4 + 3UR TYPE: **BACK ELEVATION: SCALE 1:100**




M4 + 3UR TYPE: SIDE ELEVATION: SCALE 1:100

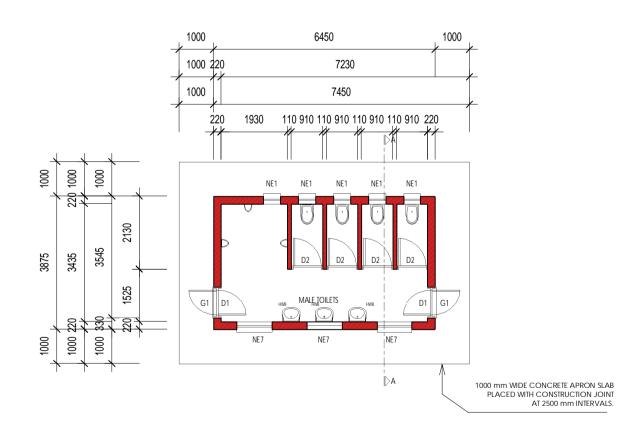


M4 + 3UR TYPE:

FLOOR PLAN: **SCALE 1:100**

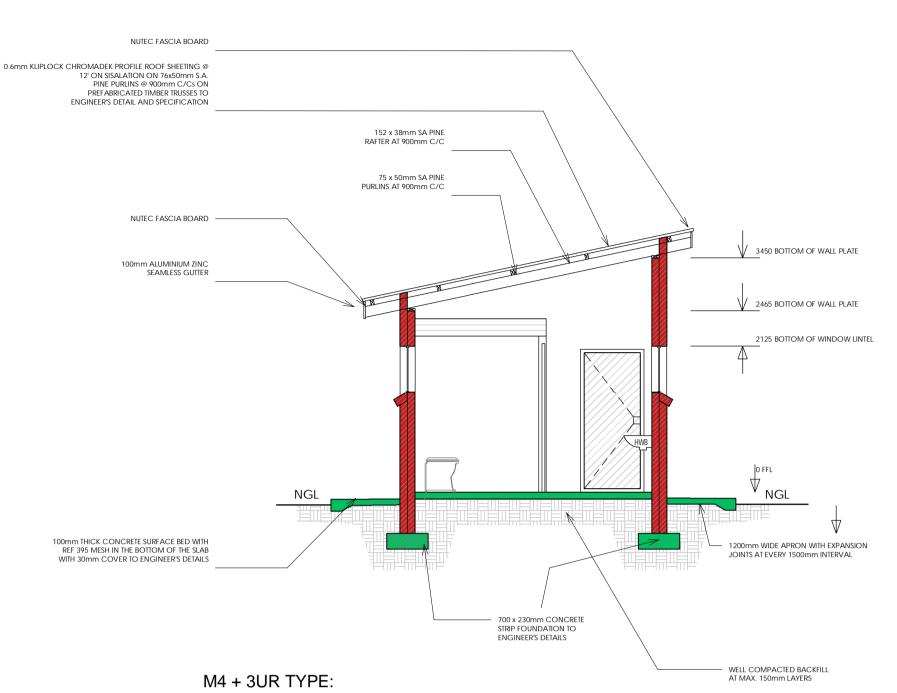


SECTION A-A: SCALE 1:50




M4 + 3UR TYPE:


SIDE ELEVATION: SCALE 1:100

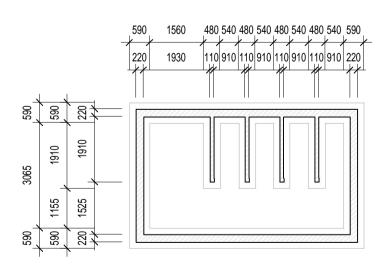


M4 + 3UR TYPE:


FOUNDATION PLAN:

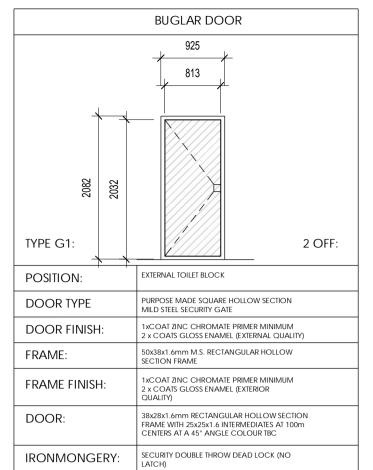

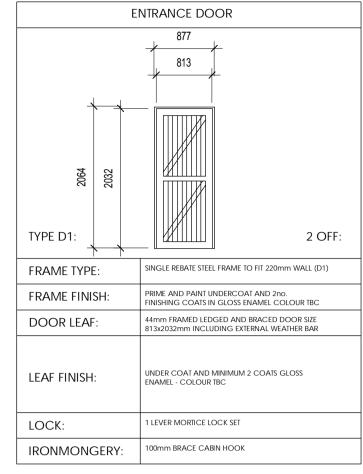


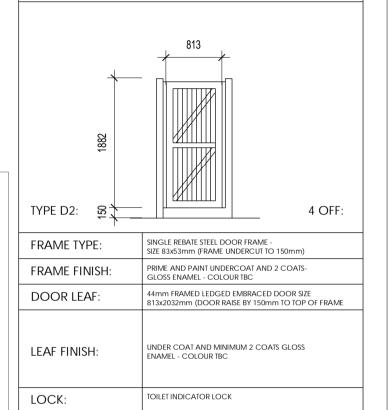


CUBICLE DOOR

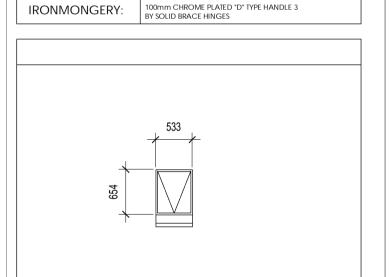

	WINDOW NO:	N1
	CATALOGUE:	NE1
	FRAME:	533 x 654mm HIGH STANDARD STEEL WINDOW FRAME
	FRAME FINISH:	SPOT PRINING DEFECTS IN PRE-PRIME SURFACE WITH ZINC CHROMATE PRIMER & APPLY ONE UNIVERSAL UNDER COAT & TWO COATS EPWP GOLDEN BROWN GLOSS ENAMEL PAINT ON STEEL
	GLAZING:	6.28mm OBSCURE SAFETY GLASS
	NO REQUIRED:	5

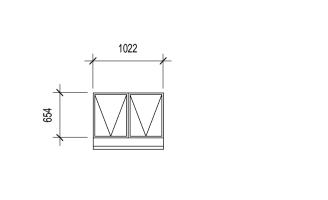

	WINDOW NO:	N2
	CATALOGUE:	NE7
	FRAME:	1022 x 654mm HIGH STANDARD STEEL WINDOW FRAME
	FRAME FINISH:	SPOT PRINING DEFECTS IN PRE-PRIME SURFACE WITH ZINC CHROMATE PRIMER & APPLY ONE UNIVERSAL UNDER COAT & TWO COATS EPWP GOLDEN BROWN GLOSS ENAMEL PAINT ON STEEL
	GLAZING:	6.28mm OBSCURE SAFETY GLASS
	NO REQUIRED:	3

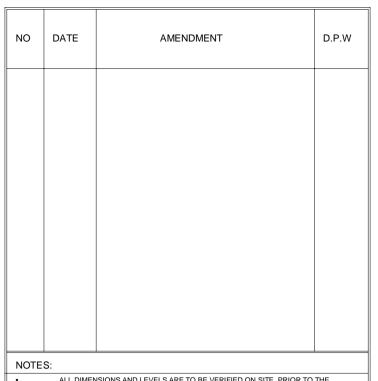

ALL DIMENSIONS AND LEVELS ARE TO BE VERIFIED ON SITE, PRIOR TO THE COMMENCEMENT OF SETTING OUT, WORKSHOP DRAWINGS OR CONSTRUCTION. FIGURED DIMENSIONS TO BE USED IN PREFERENCE TO SCALED DIMENSIONS. ANY DISCREPANCIES, ERRORS AND OMISSIONS ARE TO BE REPORTED TO THE ARCHITECT IMMEDIATELY PRIOR TO OMISSIONS ARE TO BE REPORTED TO THE ARCHITECT IMMEDIATELY PRIOR TO COMMENCING WITH ANY WORK.
ALL SHOP DRAWINGS ARE TO BE SUBMITTED TO THE ARCHITECT FOR APPROVAL PRIOR TO MANUFACTURE OR INSTALLATION.
ALL WORK IS TO BE EXECUTED IN STRICT ACCORDANCE WITH SANS CODES, BY-LAWS AND REGULATIONS OF THE LOCAL AUTHORITY.
WHERE REQUIRED, ARCHITECTURAL DRAWINGS ARE TO BE READ IN CONJUNCTION WITH THE RELEVANT CONSULTANTS' DRAWINGS. COPYRIGHT AND RIGHT OF REPRODUCTION OF THIS DRAWING OR ANY PORTION THEREOF, IS RESERVED AND REMAINS WITH CDA.
ALL CONSTRUCTION WORK MUST COMPLY WITH THE LAWS OF THE LAND, SANS 10400, THE NATIONAL BUILDING STANDARDS AND LOCAL AUTHORITY BY LAWS AND MODEL PREAMBLES.

KEYPLAN:



COPYRIGHT VESTS IN THE DEPARTMENT OF PUBLIC WORKS

DWG FILE NAME:

BENDOR 0699



TEL: 082 215 5937

CONSULTANT/DEPARTMENTAL DIATHO CONSULTING (PTY) LTD OFFICE NO: 2, IT PARK **15 PIERRE STREET** BENDOR 0699 TEL : 087 510 5242 CELL: 064 526 9369 FAX : 086 415 6426 Diatho Consulting (PTY) LTD

CONTRACTOR:

LOGO:

TLHABELENI PRIMARY SCHOOL

DRAWING TITLE: SITE DEVELOPMENT PLAN:

LIMPOPO PROVINCE

M4 + 3UR TYPE: REF NO: LE21TMT17200 DRAWN BY: K.M CHECKED BY: K.M SCALE: 1:100

VERIFIED BY: K.M TYPE NUMBER: M4 + 3UR TYPE:

W100:M4 + 3UR

GENERAL NOTES AND SPECIFICATIONS:

Use dimensions provided and do not scale drawing. All work to comply with SANS, PW371 and SABS. All dimensions, levels and positions to be verified on site prior to

construction. All concrete work to be as per Engineer's details and

specifications.

All pits to face North. All brickwork have brickforce at every 2nd course in pit lining and 3rd course in superstructure.

All stages of pit excavation to be inspected and approved by Engineer and signed off.

2. All pit lining to be inspected by EnviroLoo Services before slab

COMPACTION OF SURFACES

All ground surfaces receiving concrete floors / slab should be compacted to 150mm layers 93% ModAASHTO density before casting concrete.

All concrete to be as per Engineer's details and specifications. 25 MPa strength concrete to be used throughout construction: Trial Concrete Mixes: Proportions Concrete Strenght at 28 Days 25Mpa: 1:2:2 (mix proportion by volume) 1 bag cement: 0.08m3 Sand: 0.09m3 Stone (Volume/Bag) 385 kg cement : 820 kg sand : 960 kg stone (Mass/m3)

Pre-cast concrete lintols to be used as support under top slab of pit. All concrete aprons to be 1000mm wide.. MORTAR Mixed proportions to be: 1 cement : 3 sand (i.e.1 bag cement : 3

BRICKWORK Sub-structure

wheelbarrows (37 litres) sand)

All pit lining / foundation brickwork to be solid NFP clay brick. All internal surface of pit lining to be painted with two coats black expoxy paint installing Enviro-Loo units.

Super-structure

All external walls / partitions to be of clay face brick to SABS quality. All cubicle partition walls to be 3 courses above door height.

All brickwork above door openings should have brickforce on every course at least 3 courses.

Air bricks: Standard 230X152mm terra-colts vermin proofed lourved air grating to be used above all window openings.

ROOF SHEETING

1. 0.6mm kliplock chromadek roof sheeting.

ROOF TIMBER / CEILING

1. All roof timbers to be machined SABS treated wood with three coats of approved wood preservative.

2. Timber connections (Hurricane Clips) are required all

intercessions between timber rafters and purlins. Sisalation is to be applied interval under all roof surfaces.

METALWORK

1. All metalwork should be primed before installation. 2. All steel window should have 6x20mm flat bar burglar proofing.

PLUMBING

Double concrete wash trough to be used. All wash troughs should be connected to the school's water supply

system and the waste water should be piped to a soakaway. The soakaway should be as per Engineer's detail and position to be

determined on site. Only 20mm and galvanised pipework should be used as

connection from wall to the discharge points.

1. 6.28mm obscure safety glass 2. Stainless steel mirrors size 350x450mm high.

All paintwork to comply with SABS and PW371 specification. All steel window and door frames including doors and fascia / barge boards to be discharge points.

SCALE 1:100