


M4 + 6UR TYPE:

FRONT ELEVATION:

SCALE 1:100

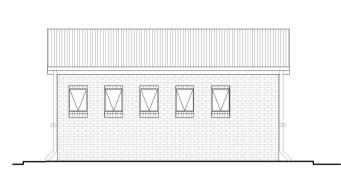

M4 + 6UR TYPE:

BACK ELEVATION:


SCALE 1:100



M4 + 6UR TYPE:

SIDE ELEVATION:


SCALE 1:100

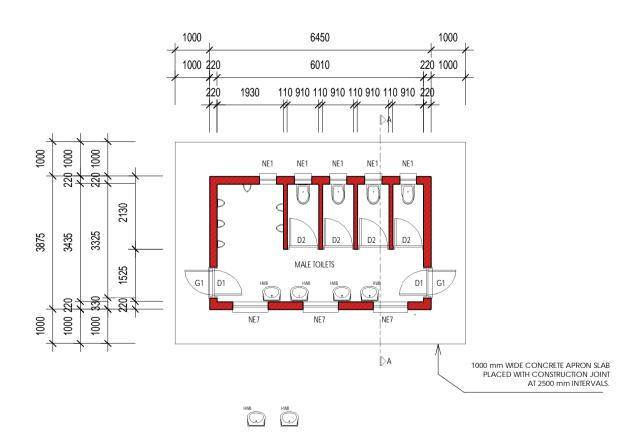

M4 + 6UR TYPE:

FLOOR PLAN:

SCALE 1:100



M4 + 6UR TYPE:

M4 + 6UR TYPE:

SCALE 1:50

SECTION A-A:

NUTEC FASCIA BOARD

NUTEC FASCIA BOARD -

SEAMLESS GUTTER

100mm THICK CONCRETE SURFACE BED WITH

152 x 38mm SA PINI RAFTER AT 900mm C/C


75 x 50mm SA PINE PURLINS AT 900mm C/C

STRIP FOUNDATION TO ENGINEER'S DETAILS

PREFABRICATED TIMBER TRUSSES TO ENGINEER'S DETAIL AND SPECIFICATION

0.6mm KLIPLOCK CHROMADEK PROFILE ROOF SHEETING @


SIDE ELEVATION: SCALE 1:100

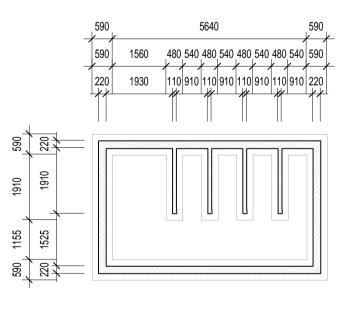



M4 + 6UR TYPE:


FOUNDATION PLAN:

SCALE 1:100

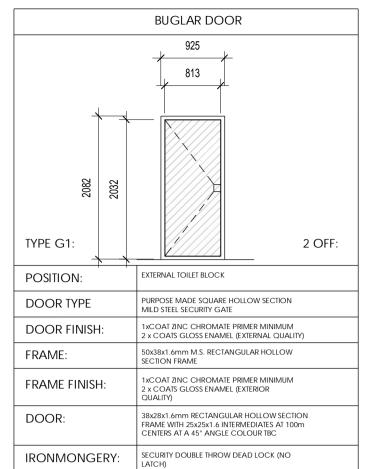

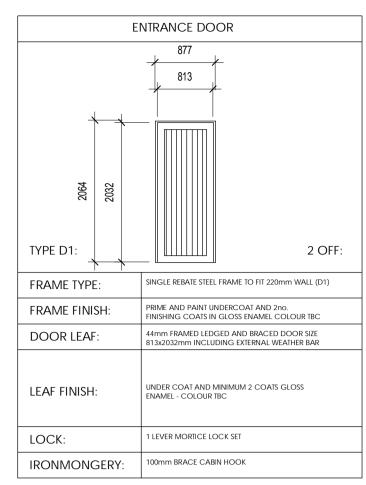

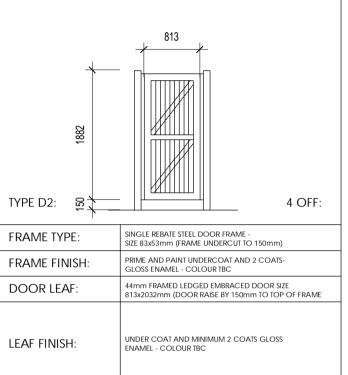

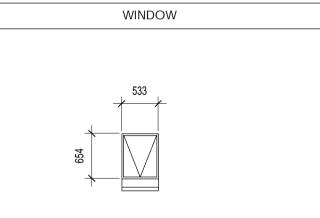

TOILET INDICATOR LOCK

IRONMONGERY:


100mm CHROME PLATED "D" TYPE HANDLE 3 BY SOLID BRACE HINGES

	WINDOW NO:	N1
	CATALOGUE:	NE1
	FRAME:	533 x 654mm HIGH STANDARD STEEL WINDOW FRAME
	FRAME FINISH:	SPOT PRINING DEFECTS IN PRE-PRIME SURFACE WITH ZINC CHROMATE PRIMER & APPLY ONE UNIVERSAL UNDER COAT & TWO COATS EPWP GOLDEN BROWN GLOSS ENAMEL PAINT ON STEEL
	GLAZING:	6.28mm OBSCURE SAFETY GLASS
	NO REQUIRED:	5

~	1022	
654		

WINDOW

WINDOW NO:	N2
CATALOGUE:	NE7
FRAME:	1022 x 654mm HIGH STANDARD STEEL WINDOW FRAME
FRAME FINISH:	SPOT PRINING DEFECTS IN PRE-PRIME SURFACE WITH ZINC CHROMATE PRIMER & APPLY ONE UNIVERSAL UNDER COAT & TWO COATS EPWP GOLDEN BROWN GLOSS ENAMEL PAINT ON STEEL
GLAZING:	6.28mm OBSCURE SAFETY GLASS
NO REQUIRED:	3

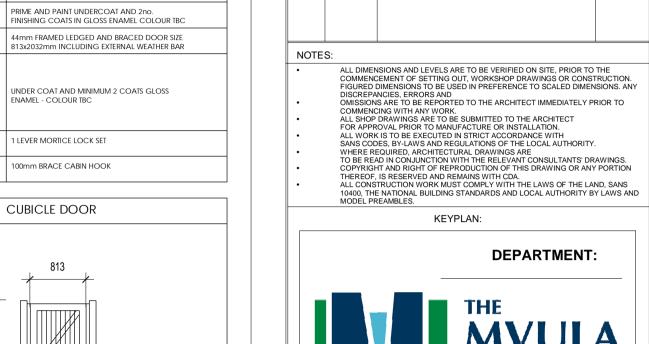

DATE

AMENDMENT


A leading developmental NGO SPONSOR: **COPYRIGHT VESTS IN THE DEPARTMENT OF PUBLIC WORKS**

D.P.W

DWG FILE NAME:



TEL: 082 215 5937 BENDOR 0699 CONSULTANT/DEPARTMENTAL DIATHO CONSULTING (PTY) LTD OFFICE NO: 2, IT PARK **15 PIERRE STREET** BENDOR 0699 TEL : 087 510 5242 CELL: 064 526 9369 FAX : 086 415 6426 Diatho Consulting (PTY) LTD **CONTRACTOR:**

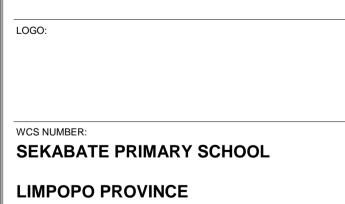

M4 + 6UR TYPE: REF NO: -DRAWN BY: K.M CHECKED BY: K.M SCALE: 1:100 DATE: **09.2023 VERIFIED BY: K.M**

WATER-BORNE ABLUTIONS:

DRAWING TITLE:

TYPE NUMBER:

M4 + 6UR TYPE: W100:M4 + 6UR

2. All pit lining to be inspected by EnviroLoo Services before slab COMPACTION OF SURFACES All ground surfaces receiving concrete floors / slab should be compacted to 150mm layers 93% ModAASHTO density before casting concrete.

All concrete to be as per Engineer's details and specifications. 25 MPa strength concrete to be used throughout construction: Trial Concrete Mixes: Proportions Concrete Strenght at 28 Days 25Mpa: 1 : 2 : 2 (mix proportion by volume) 1 bag cement : 0.08m3 Sand : 0.09m3 Stone (Volume/Bag) 385 kg cement : 820 kg sand : 960 kg stone (Mass/m3)

Pre-cast concrete lintols to be used as support under top slab of pit. All concrete aprons to be 1000mm wide. MORTAR Mixed proportions to be: 1 cement : 3 sand (i.e.1 bag cement : 3 wheelbarrows (37 litres) sand)

BRICKWORK Sub-structure

1. All pit lining / foundation brickwork to be solid NFP clay brick. 2. All internal surface of pit lining to be painted with two coats black expoxy paint installing Enviro-Loo units.

Super-structure

GENERAL

construction.

specifications.

casting.

All pits to face North.

3rd course in superstructure.

Engineer and signed off.

NOTES AND SPECIFICATIONS:

Use dimensions provided and do not scale drawing.

All concrete work to be as per Engineer's details and

All dimensions, levels and positions to be verified on site prior to

All brickwork have brickforce at every 2nd course in pit lining and

All stages of pit excavation to be inspected and approved by

All work to comply with SANS, PW371 and SABS.

2465 BOTTOM OF WALL PLATE

2125 BOTTOM OF WINDOW LINTEL

1200mm WIDE APRON WITH EXPANSION

WELL COMPACTED BACKFILL

All external walls / partitions to be of clay face brick to SABS quality. All cubicle partition walls to be 3 courses above door height. All brickwork above door openings should have brickforce on every

course at least 3 courses. 4. Air bricks: Standard 230X152mm terra-colts vermin proofed lourved air grating to be used above all window openings.

1. 0.6mm kliplock chromadek roof sheeting.

ROOF TIMBER / CEILING

1. All roof timbers to be machined SABS treated wood with three coats of approved wood preservative.

2. Timber connections (Hurricane Clips) are required all intercessions between timber rafters and purlins.

Sisalation is to be applied interval under all roof surfaces.

METALWORK

1. All metalwork should be primed before installation. 2. All steel window should have 6x20mm flat bar burglar

Double concrete wash trough to be used. All wash troughs should be connected to the school's water supply

system and the waste water should be piped to a soakaway. The soakaway should be as per Engineer's detail and position to be

4. Only 20mm and galvanised pipework should be used as connection from wall to the discharge points.

2. Stainless steel mirrors size 350x450mm high.

PAINTING

1. All paintwork to comply with SABS and PW371 specification.

1. 6.28mm obscure safety glass All steel window and door frames including doors and fascia / barge boards to be discharge points.