


PART 4: SITE INFORMATION

Document reference	Title	No of pages
C4	This cover page	1
	Site Information	3
	Total number of pages	4

PART 4: SITE INFORMATION

1. General description

Line route between Aggeneys Substation (Aggeneys Town) and Paulputs Substation ( Poffadder Town )

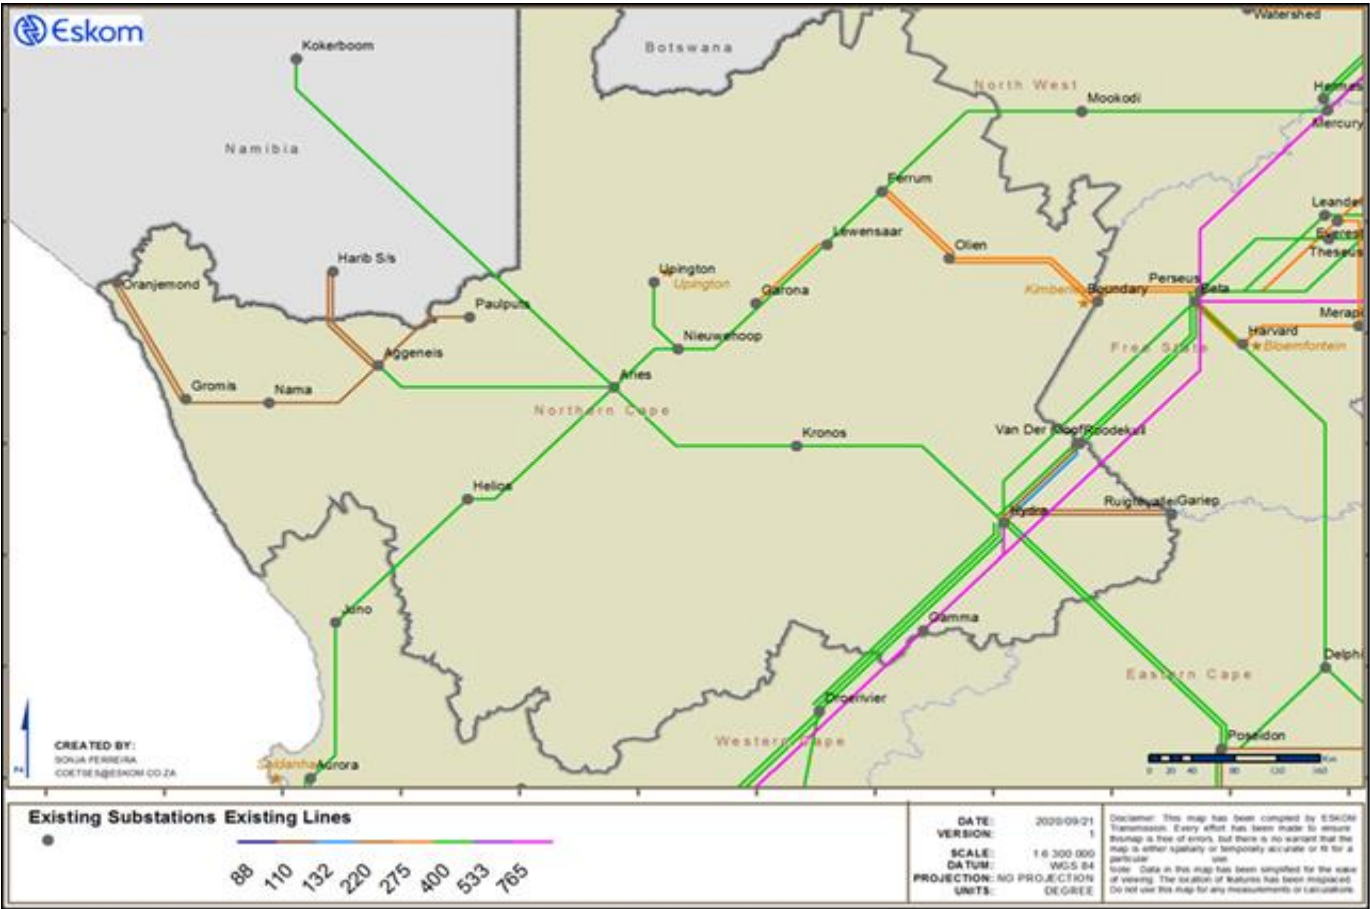


### **Aggeneys Substation**

- Province: Northern Cape
- City/Town: Aggeneys
- Municipality: Namakwa District Municipality
- GPS Coordinates- S30 29.977, E19 33.622
- Construction area: extension of a new 400 kV feeder bay



### **Paulputs Substation**

- Province: Northern Cape
- City/Town: Puffadder
- Municipality: Namakwa District Municipality
- GPS Coordinates- S28.88.196, E19 56.66.15
- Construction area: New 400kV Yard

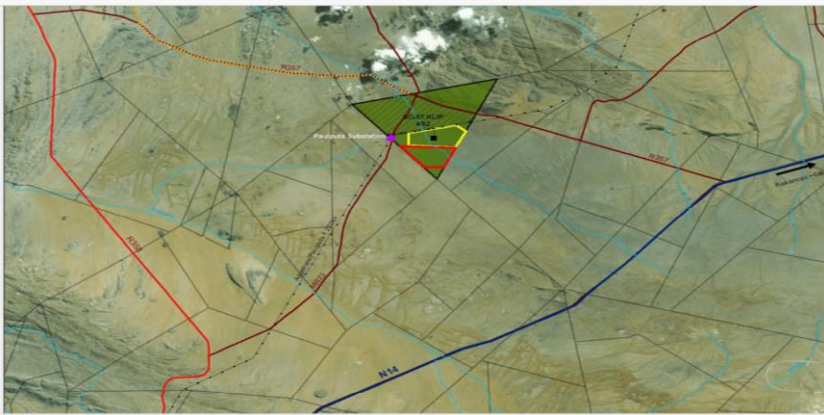

## **2. Existing buildings, structures, and plant & machinery on Site**

If the works have interfaces or hook up points with existing facilities or comprise refurbishment of existing facilities, provide full details of these so that the tendering contractor can plan his design and construction to integrate with them as the Works Information requires. As built drawings of the existing facilities usually provide the necessary information; such drawings can be listed here stating where they are located for the Contractor's use.

### **3. Subsoil information**

Subsoil information will be confirmed during construction.

### **4. Hidden services**

Existing hidden services information will be confirmed during construction.

### **5. Other reports and publicly available information**

No information to provide.

As per documents, report, standards, and specifications provided.