


TOP VIEW - TYPE B ANCHOR

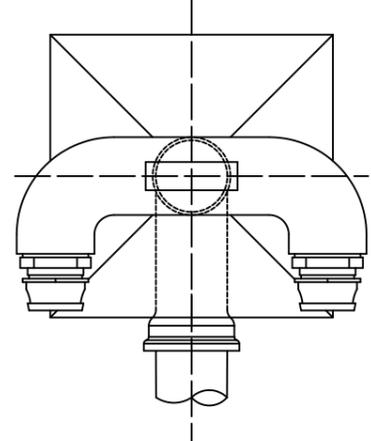

TOP VIEW - TYPE A ANCHOR

NOTE

See Standard Specification for equipment details.
 Type B Anchor blocks are required where hydrants are exposed to vehicle damage.
 Covered mild steel piping must be corrosion protected with bitumen tape.
 Paint all exposed portions of piping and anchors.

SYMBOLS LEGEND

-  - FPC (FIRE PUMP CONNECTION)
-  - RISER PIPE

FIRE PUMP CONNECTION (BOOSTER POINT)

NTS

0	03/18	Issued for Construction
REV No	DATE :	DESCRIPTION:
REVISIONS		
SIZE ON ORIGINAL DRAWING 100 mm		
 DEPARTMENT OF INFRASTRUCTURE DEVELOPMENT		
INSTITUTION		
STANDARD DRAWING		
STAND /ERF/PLOT DESCRIPTION		
ALL		
SERVICE		
FIRE HYDRANTS		
BOC	BUILDING / SITE DESCRIPTION	STAGE
A3	SITE	5
DISCIPLINE		
MECHANICAL		
WORK DESCRIPTION - SUB DIVISION		
FIRE PROTECTION		
DRAWING DESCRIPTION		
FIRE PUMP CONNECTION - FPC - DETAIL		
FILE No.	Departmental	DESIGN
		DRAWN
SCALE	NTS	CHECKED
RESPONSIBLE PROFESSIONAL		
DATE	NAME	SIGNATURE
		PR NUMBER
DRAWING CO-ORDINATED		
CONSULTANT :		
DEPARTMENTAL		
CONTRACTOR :		
CAD SYSTEM	CADDIE	FILE NAME
SIZE	DRAWING NUMBER	REV
A3	ME-E 01 04 03	0