


TOP VIEW - TYPE B CONCRETE ANCHOR

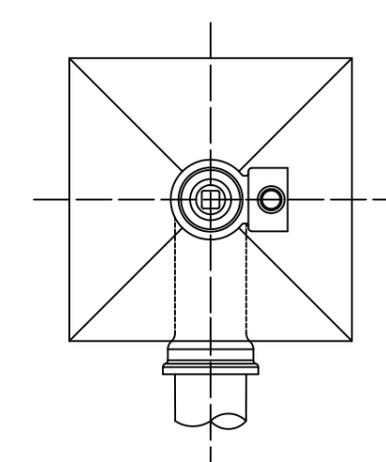

TOP VIEW - TYPE A ANCHOR

NOTE

- See Standard Specification for equipment details and requirements.
- Type B Anchor blocks are required where hydrants are exposed to vehicle damage.
- Covered galvanized mild steel piping must be corrosion protected with bitumen tape.
- Paint all exposed portions of piping and anchors.

SYMBOLS LEGEND

- FH (FIRE HYDRANT)
- RISER PIPE

FIRE HYDRANT

NTS

0	03/18	Issued for Construction	
REV No	DATE :	DESCRIPTION:	
REVISIONS			
SIZE ON ORIGINAL DRAWING 100 mm			
 DEPARTMENT OF INFRASTRUCTURE DEVELOPMENT			
INSTITUTION			
STANDARD DRAWING			
STAND /ERF/PLOT DESCRIPTION			
ALL			
SERVICE			
FIRE HYDRANTS			
BOC	BUILDING / SITE DESCRIPTION	STAGE	
A3	SITE	5	
DISCIPLINE			
MECHANICAL			
WORK DESCRIPTION - SUB DIVISION			
FIRE PROTECTION			
DRAWING DESCRIPTION			
FIRE HYDRANT - FH - DETAIL			
FILE No.	Departmental	DESIGN	
		DRAWN	
SCALE	NTS	CHECKED	
RESPONSIBLE PROFESSIONAL - DESIGN			
DATE	NAME	SIGNATURE	PR NUMBER
RESPONSIBLE PROFESSIONAL - CO-ORDINATION			
CONSULTANT :			
DEPARTMENTAL			
(Education: Infrastructure and Maintenance - Schools)			
CONTRACTOR :			
CAD SYSTEM	CADDIE	010401-0	FILE NAME
SIZE	DRAWING NUMBER		REV
A3	ME-E 01 04 01		0