





DRAWING SEE SHEETS 3, 4 AND 5

SAP MATERIAL No.:	0168788							
SHORT DESCRIPTION:	BOX DISTR:POLE TOP; 2-WAY; 50A;WD 180 MM							
TECH. DESCRIPTION:								
<p>BOX, DISTRIBUTION: TYPE: POLE TOP; 2-WAY; 50A; WIDTH: 180 MM; LENGTH: 300 MM; DEPTH: 120 MM; MATERIAL: NON-METAL; WITH TWO HOLES FOR 2 X M6 COACH SCREWS FOR SECURING TO WOOD POLE; BOX SUPPLIED AND FITTED WITH THE FOLLOWING :- 2 X NUMBER X COMPRESSION GLANDS, 1 X 3-WAY NEUTRAL BAR, 2 X 1.5M X 16MM SQ. UV STABLE PVC INSULATED COPPER LEADS; 1 X 50A MINIATURE CIRCUIT BREAKER (MCB) (D-DT-3083); DIN RAIL MOUNTING TO ALLOW FOR ADDITIONAL MCB; USED FOR 2 X 20 AMP CUSTOMERS * SUPPLIED WITH 2 X M6X40MM COACH SCREWS (ELECTROPLATED TO SANS 728), AND 1 X EXTERNAL TOGGLE LEVER FOR LINK STICK; WITH RESET LOOP NOT LESS THAN 30MM SQ. IN DIA; PROVISION FOR CONCRETE POLE MOUNTING ESKOM DRAWING No. D-DT-3055 *</p>								
ITEM	:- BOX,POLE TOP DIST 2, 4 AND 8-WAY							
MATERIAL SPECIFICATION	:-							
CORROSION SPECIFICATION	:-							
STANDARD SPECIFICATION	:- NRS 032							
ESKOM SPECIFICATION	:- 34-1705							
TEST & CERTIFICATION REQUIREMENTS :-								
INSPECTION	Yes	No	ESKOM RELEASE NOTE			Yes	No	
IDENTIFICATION:- INDELIBLE MANUFACTURES TRADEMARK & PART No. ON ALL ITEMS								
24	DIMENSIONS ALLIGNED WITH DESIGN DRAWINGS		JS	H GROENEWALD	H GROENEWALD	18.08.2022		
23	NEW DESIGNS CREATED FOR SPLIT METER KIOSKS		JS	H GROENEWALD	H GROENEWALD	15.10.2021		
22	EXTERNAL TOGGLE LEVERS ADDED TO120A PTB		P.A.T.	J. MAUDU	J. MAUDU	29.07.2015		
21	ESKOM SPEC. CORRECTED		P.A.T.	J. MAUDU	J. MAUDU	12.06.2014		
20	ALL SPLIT METERS NO. OF S.A.'S CHANGED		P.A.T.	J. MAUDU	J. MAUDU	22.01.2010		
REV	REVISION DESCRIPTION		BY	CHKD	AUTH	DATE	REF. DWGS	
AUTH:	S.A. CILLIERS	DATE:	MARCH 93	 D-DT-3055		SAP No:		
CHKD:		DATE:				0168788		
DRAWN:	Z. WATSON	DATE:	14-09-92			SET	SHEET	REV
						9	1	24

Unique Identifier: 240-48887441

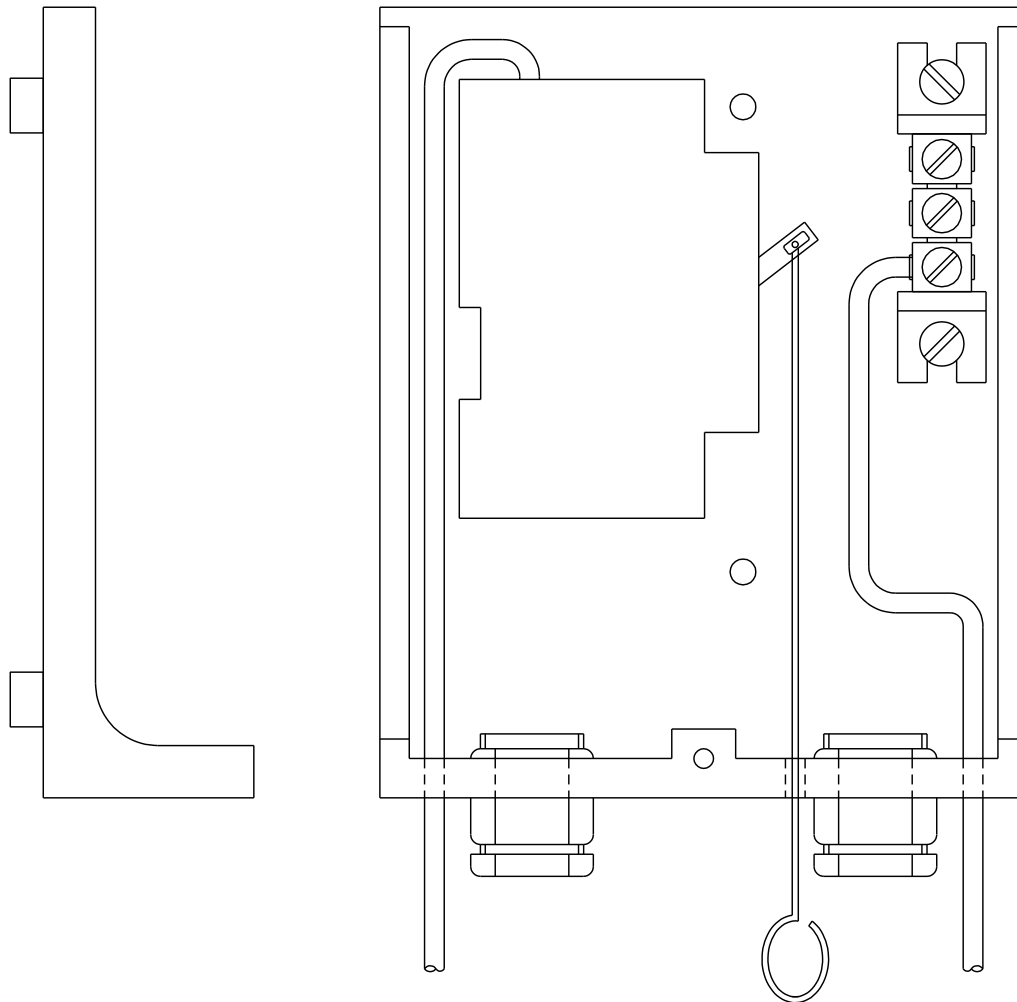
Revision 1

SPEC SHEET

SAP MATERIAL No.:	0168574								
SHORT DESCRIPTION:	BOX DISTR:POLE TOP; 4-WAY; 50A;WD 340 MM								
TECH. DESCRIPTION:									
BOX, DISTRIBUTION: TYPE: POLE TOP; 4-WAY; 50A; WIDTH: 340 MM; LENGTH: 300 MM; DEPTH: 120 MM; MATERIAL: NON-METAL; PROVISION FOR TWO STAINLESS STEEL STRAPS 12MM WIDE X 0.75MM THICK FOR SECURING AROUND A ROUND OR SQUARE POLE; BOX SUPPLIED AND FITTED WITH THE FOLLOWING :- 4 X NUMBER X COMPRESSION GLANDS, 1 X 13MM DIA. STREETLIGHT ENTRY HOLE, 1 X 6-WAY LIVE BAR, 1 X 6-WAY NEUTRAL BAR, 2 X 16MM UV STABLE PVC INSULATED COPPER LEADS; 1 X 50A MINIATURE CIRCUIT BREAKER (MCB) (D-DT-3083); AND 1 X EXTERNAL TOGGLE LEVER FOR LINK STICK WITH RESET LOOP NOT LESS THAN 30MM IN DIA; USED FOR 4X20 AMP CUSTOMERS ESKOM DRAWING No. D-DT-3055 *									
SAP MATERIAL No.:	0168787								
SHORT DESCRIPTION:	BOX DISTR:POLE TOP; 4-WAY; 120A;120 MM								
TECH. DESCRIPTION:									
BOX, DISTRIBUTION: TYPE: POLE TOP; 4-WAY; 120A; WIDTH: 340 MM; LENGTH: 300 MM; DEPTH: 120 MM; MATERIAL: NON-METAL; PROVISION FOR TWO STAINLESS STEEL STRAPS 12MM WIDE X 0.75MM THICK FOR SECURING AROUND A ROUND OR SQUARE POLE; BOX SUPPLIED AND FITTED WITH THE FOLLOWING :- 4 X NUMBER X COMPRESSION GLANDS, 1 X 13MM DIA. STREETLIGHT ENTRY HOLE, 1 X 6-WAY LIVE BAR, 1 X 6-WAY NEUTRAL BAR, 4 X 1.5M X 16MM OR 2 X 1.5M X 25MM UV STABLE PVC INSULATED COPPER LEADS TO BE FITTED; 1 X 120A MINIATURE CIRCUIT BREAKER (MCB) (D-DT-3083); 1 X EXTERNAL TOGGLE LEVER FOR LINK STICK WITH RESET LOOP NOT LESS THAN 30MM IN DIA.; USED FOR 4X60 AMP CUSTOMERS ESKOM DRAWING No. D-DT-3055 *									
SAP MATERIAL No.:	0168710								
SHORT DESCRIPTION:	BOX DISTR:POLE TOP; 8-WAY; 50A;WD 340 MM								
TECH. DESCRIPTION:									
BOX, DISTRIBUTION: TYPE: POLE TOP; 8-WAY; 50A; WIDTH: 340 MM; LENGTH: 550 MM; DEPTH: 120 MM; MATERIAL: NON-METAL; PROVISION FOR TWO STAINLESS STEEL STRAPS 12MM WIDE X 0.75MM THICK FOR SECURING AROUND A ROUND OR SQUARE POLE; BOX SUPPLIED AND FITTED WITH THE FOLLOWING :- 8 X NUMBER X COMPRESSION GLANDS, 1 X 13MM DIA. STREETLIGHT ENTRY HOLE, 2 X 6-WAY LIVE BARS, 1 X 10-WAY NEUTRAL BAR, 3 X 1.5M X 16MM UV STABLE PVC INSULATED COPPER LEADS TO BE FITTED; 2 X 50A MINIATURE CIRCUIT BREAKERS (MCB'S) (D-DT-3083); USED FOR 8X20 AMP CUSTOMERS ESKOM DRAWING No. D-DT-3055 *									
24	DIMENSIONS ALLIGNED WITH DESIGN DRAWINGS		JS	H GROENEWALD	H GROENEWALD	18.08.2022			
23	NEW DESIGNS CREATED FOR SPLIT METER KIOSKS		JS	H GROENEWALD	H GROENEWALD	15.10.2021			
22	EXTERNAL TOGGLE LEVERS ADDED TO120A PTB		P.A.T.	J. MAUDU	J. MAUDU	29.07.2015			
21	ESKOM SPEC. CORRECTED		P.A.T.	J. MAUDU	J. MAUDU	12.06.2014			
20	ALL SPLIT METERS NO. OF S.A.'S CHANGED		P.A.T.	J. MAUDU	J. MAUDU	22.01.2010			
REV	REVISION DESCRIPTION			BY	CHKD	AUTH	DATE		
AUTH:	S.A. CILLIERS	DATE:	MARCH 93	SCALE				SAP No:	
CHKD:		DATE:		NTS				0168574	
				CAD REF:				0168787	
				SERIES 3000	D-DT-3055			SET	
				FILE No:				9	
DRAWN:	Z. WATSON	DATE:	14-09-92	3055				SHEET	
								REV	
								24	

Unique Identifier: 240-48887441

Revision 1



2 WAY BOX

NOTE :
SKETCH NOT FOR
MANUFACTURING PURPOSES.

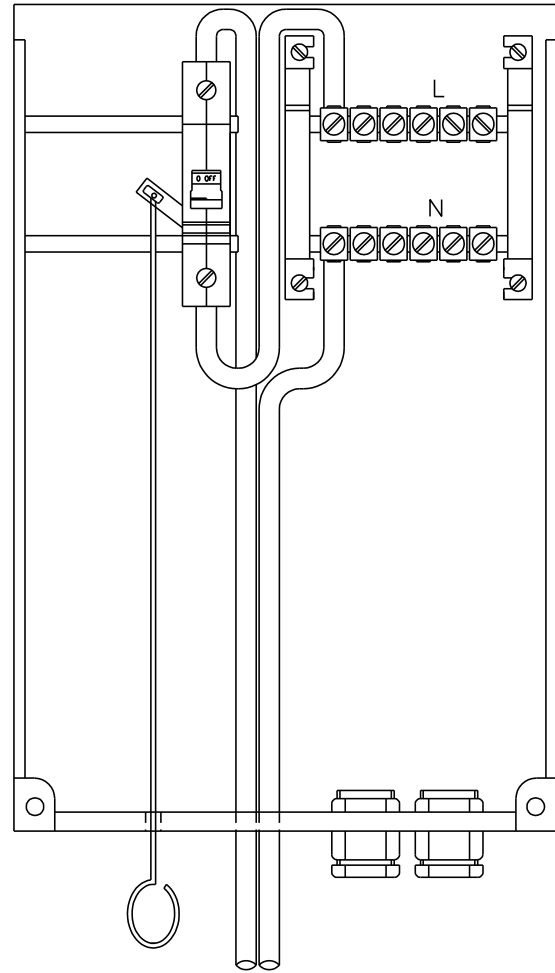
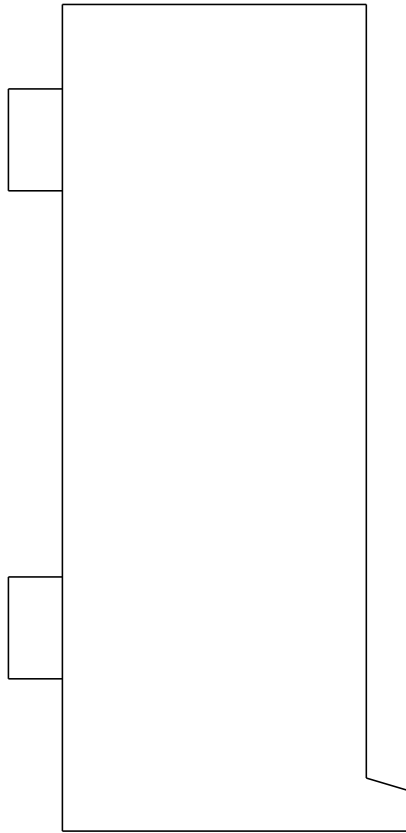
24	DIMENSIONS ALLIGNED WITH DESIGN DRAWINGS	JS	H GROENEWALD	H GROENEWALD	18.08.2022	
23	NEW DESIGNS CREATED FOR SPLIT METER KIOSKS	JS	H GROENEWALD	H GROENEWALD	15.10.2021	
22	EXTERNAL TOGGLE LEVERS ADDED TO120A PTB	P.A.T.	J. MAUDU	J. MAUDU	29.07.2015	
21	ESKOM SPEC. CORRECTED	P.A.T.	J. MAUDU	J. MAUDU	12.06.2014	
20	ALL SPLIT METERS NO. OF S.A.'S CHANGED	P.A.T.	J. MAUDU	J. MAUDU	22.01.2010	
REV	REVISION DESCRIPTION	BY	CHKD	AUTH	DATE	REF. DWGS
AUTH:	S.A. CILLIERS	DATE:	MARCH 93	SCALE	SAP No:	
				NTS		
CHKD:		DATE:		CAD REF:	0168788	
				SERIES 3000	SET	SHEET
DRAWN:	Z. WATSON	DATE:	14-09-92	FILE No:	9	3
				3055		24



D-DT-3055

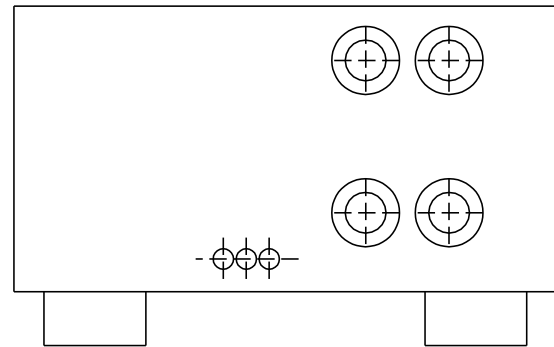
Unique Identifier: 240-48887441



Revision 1



4 WAY BOX

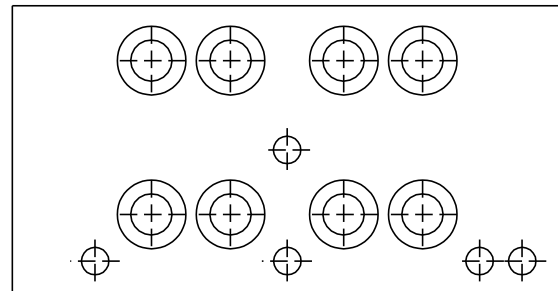
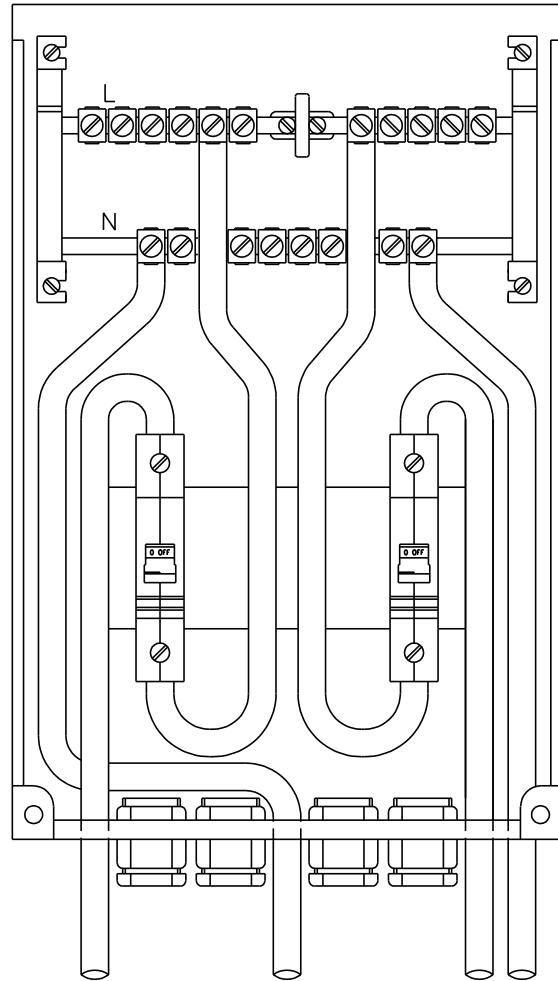
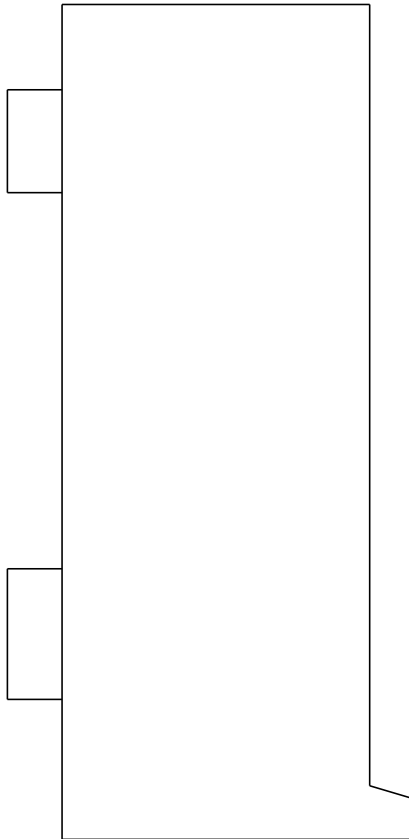
NOTE :
SKETCH NOT FOR
MANUFACTURING PURPOSES.



24	DIMENSIONS ALIGNED WITH DESIGN DRAWINGS			JS	H GROENEWALD	H GROENEWALD	18.08.2022				
23	NEW DESIGNS CREATED FOR SPLIT METER KIOSKS			JS	H GROENEWALD	H GROENEWALD	15.10.2021				
22	EXTERNAL TOGGLE LEVERS ADDED TO120A PTB			P.A.T.	J. MAUDU	J. MAUDU	29.07.2015				
21	ESKOM SPEC. CORRECTED			P.A.T.	J. MAUDU	J. MAUDU	12.06.2014				
20	ALL SPLIT METERS NO. OF S.A.'S CHANGED			P.A.T.	J. MAUDU	J. MAUDU	22.01.2010				
REV	REVISION DESCRIPTION				BY	CHKD	AUTH	DATE	REF. DWGS		
AUTH:	S.A. CILLIERS	DATE:	MARCH 93	SCALE	 D-DT-3055			SAP No:			
				NTS				0168574			
CHKD:		DATE:		CAD REF:				0168787			
				SERIES 3000				SET	SHEET	REV	
DRAWN:	Z. WATSON	DATE:	14-09-92	FILE No:				9	4	24	
				3055							



Unique Identifier: 240-48887441

Revision 1



8 WAY BOX



NOTE :
SKETCH NOT FOR
MANUFACTURING PURPOSES.

24	DIMENSIONS ALIGNED WITH DESIGN DRAWINGS			JS	H GROENEWALD	H GROENEWALD	18.08.2022		
23	NEW DESIGNS CREATED FOR SPLIT METER KIOSKS			JS	H GROENEWALD	H GROENEWALD	15.10.2021		
22	EXTERNAL TOGGLE LEVERS ADDED TO120A PTB			P.A.T.	J. MAUDU	J. MAUDU	29.07.2015		
21	ESKOM SPEC. CORRECTED			P.A.T.	J. MAUDU	J. MAUDU	12.06.2014		
20	ALL SPLIT METERS NO. OF S.A.'S CHANGED			P.A.T.	J. MAUDU	J. MAUDU	22.01.2010		
REV	REVISION DESCRIPTION				BY	CHKD	AUTH	DATE	REF. DWGS
AUTH:	S.A. CILLIERS	DATE:	MARCH 93	SCALE	 D-DT-3055		SAP No:		
				NTS			0168710		
CHKD:		DATE:		CAD REF:					
				SERIES 3000			SET	SHEET	REV
DRAWN:	Z. WATSON	DATE:	14-09-92	FILE No:			9	5	24
				3055					

Unique Identifier: 240-48887441

Revision 1



SPEC SHEET

SAP MATERIAL No.:	0245949								
SHORT DESCRIPTION:	BOX DISTR:POLE TOP SPLIT METER 2-WAY 20A								
TECH. DESCRIPTION: BOX, DISTRIBUTION: TYPE: POLE TOP SPLIT METER 2-WAY 20A; WIDTH: 200 MM; LENGTH: 300 MM; DEPTH: 120 MM; MATERIAL: NON-METAL; PROVISION FOR TWO STAINLESS STEEL STRAPS 12MM WIDE X 0.75MM THICK FOR SECURING AROUND A POLE OR SQUARE POLE; SUPPLIED AND FITTED WITH:- 5 X NUMBER 1 HIGH STRENGTH COMPRESSION GLANDS, 2 X 1.5M X 10MM SQ. UV STABLE PVC INSULATED COPPER LEADS, 1 X 50A MINIATURE CIRCUIT BREAKER (MCB) (D-DT 3083), 1 X NEUTRAL BUSBAR INTERNAL WIRING 1 X DIN RAIL FOR THE FITMENT OF THE MCB AND METERS AND 1 X 5KA/5KV SURGE ARRESTOR; USED FOR 2 X 20 AMP CUSTOMERS; LAYOUT AND WIRING AS PER D-DT-1042; ESKOM DRAWING No. D-DT-3055 *									
SAP MATERIAL No.:	0670228								
SHORT DESCRIPTION:	BOX DISTR:POLE TOP SPLITMETER 2-WAY 60A								
TECH. DESCRIPTION: BOX, DISTRIBUTION: TYPE: POLE TOP SPLITMETER 2-WAY 60A; WIDTH: 200 MM; LENGTH: 300 MM; DEPTH: 120 MM; MATERIAL: NON-METAL; PROVISION FOR TWO STAINLESS STEEL STRAPS 12MM WIDE X 0.75MM THICK FOR SECURING AROUND A POLE OR SQUARE POLE; SUPPLIED AND FITTED WITH:- 5 X NUMBER 1 HIGH STRENGTH COMPRESSION GLANDS, 2 X 1.5M X 16MM SQ. UV STABLE PVC INSULATED COPPER LEADS, 2 X 63A MINIATURE CIRCUIT BREAKER (MCB) (D-DT 3083), 1 X NEUTRAL BUSBAR INTERNAL WIRING 1 X DIN RAIL FOR THE FITMENT OF THE MCB AND METERS AND 1 X 5KA/5KV SURGE ARRESTOR; USED FOR 2 X 60 AMP CUSTOMERS; LAYOUT AND WIRING AS PER D-DT-1042; ESKOM DRAWING No. D-DT-3055 *									
ITEM	:- BOX,POLE TOP SPLIT METER BOX								
MATERIAL SPECIFICATION	:-								
CORROSION SPECIFICATION	:-								
STANDARD SPECIFICATION	:- NRS 032								
ESKOM SPECIFICATION	:- 240-75659760, D-DT-1042, 1043, 1044, 1045								
TEST & CERTIFICATION REQUIREMENTS :-									
INSPECTION	Yes	No	ESKOM RELEASE NOTE			Yes	No		
IDENTIFICATION:- INDELIBLE MANUFACTURES TRADEMARK & PART No. ON ALL ITEMS									
24	DIMENSIONS ALLIGNED WITH DESIGN DRAWINGS		JS	H GROENEWALD	H GROENEWALD	18.08.2022			
23	NEW DESIGNS CREATED FOR SPLIT METER KIOSKS		JS	H GROENEWALD	H GROENEWALD	15.10.2021			
22	EXTERNAL TOGGLE LEVERS ADDED TO 120A PTB		P.A.T.	J. MAUDU	J. MAUDU	29.07.2015			
21	ESKOM SPEC. CORRECTED		P.A.T.	J. MAUDU	J. MAUDU	12.06.2014			
20	ALL SPLIT METERS NO. OF S.A.'S CHANGED		P.A.T.	J. MAUDU	J. MAUDU	22.01.2010			
REV	REVISION DESCRIPTION			BY	CHKD	AUTH	DATE		
AUTH:	S.A. CILLIERS	DATE:	MARCH 93	SCALE				SAP No:	
CHKD:		DATE:		NTS				0245949	
				CAD REF:				0670228	
				SERIES 3000	D-DT-3055			SET	
				FILE No:				9	SHEET
				3055				6	REV
DRAWN:	Z. WATSON	DATE:	14-09-92					24	

Unique Identifier: 240-48887441

Revision 1



SPEC SHEET

SAP MATERIAL No.:	0229922								
SHORT DESCRIPTION:	BOX DISTR:POLE TOP SPLIT METER 4-WAY 20A								
TECH. DESCRIPTION: BOX, DISTRIBUTION: TYPE: POLE TOP SPLIT METER 4-WAY 20A; WIDTH: 400 MM; LENGTH: 300 MM; DEPTH: 120 MM; MATERIAL: NON-METAL; PROVISION FOR TWO STAINLESS STEEL STRAPS 12MM WIDE X 0.75MM THICK FOR SECURING AROUND A POLE OR SQUARE POLE; SUPPLIED AND FITTED WITH:- 7 X NUMBER 1 HIGH STRENGTH COMPRESSION GLANDS, 2 X 1.5M X 16MM SQ. UV STABLE PVC INSULATED COPPER LEADS, 2 X 50A MINIATURE CIRCUIT BREAKERS (MCB) (D-DT 3083), 1 X NEUTRAL BUSBAR INTERNAL WIRING 1 X DIN RAIL FOR THE FITMENT OF THE MCBS AND METERS AND 2 X 5KA/5KV SURGE ARRESTORS; USED FOR 4 X 20 AMP CUSTOMERS; LAYOUT AND WIRING AS PER D-DT-1043; ESKOM DRAWING No. D-DT-3055 *									
SAP MATERIAL No.:	0245950								
SHORT DESCRIPTION:	BOX DISTR:POLETOP SPLIT METER 4-WAY 60A								
TECH. DESCRIPTION: BOX, DISTRIBUTION: TYPE: POLETOP SPLIT METER 4-WAY 60A; WIDTH: 400 MM; LENGTH: 300 MM; DEPTH: 120 MM; MATERIAL: NON-METAL; PROVISION FOR TWO STAINLESS STEEL STRAPS 12MM WIDE X 0.75MM THICK FOR SECURING AROUND A POLE OR SQUARE POLE; SUPPLIED AND FITTED WITH:- 9 X NUMBER 1 HIGH STRENGTH COMPRESSION GLANDS, 4 X 1.5M X 16MM SQ. UV STABLE PVC INSULATED COPPER LEADS, 4 X 63A MINIATURE CIRCUIT BREAKER (MCB) (D-DT 3083), 1 X NEUTRAL BUSBAR INTERNAL WIRING 1 X DIN RAIL FOR THE FITMENT OF THE MCBS AND METERS AND 2 X 5KA/5KV SURGE ARRESTORS; USED FOR 4 X 60 AMP CUSTOMERS; LAYOUT AND WIRING AS PER D-DT-1043; ESKOM DRAWING No. D-DT-3055 *									
24	DIMENSIONS ALLIGNED WITH DESIGN DRAWINGS		JS	H GROENEWALD	H GROENEWALD	18.08.2022			
23	NEW DESIGNS CREATED FOR SPLIT METER KIOSKS		JS	H GROENEWALD	H GROENEWALD	15.10.2021			
22	EXTERNAL TOGGLE LEVERS ADDED TO 120A PTB		P.A.T.	J. MAUDU	J. MAUDU	29.07.2015			
21	ESKOM SPEC. CORRECTED		P.A.T.	J. MAUDU	J. MAUDU	12.06.2014			
20	ALL SPLIT METERS NO. OF S.A.'S CHANGED		P.A.T.	J. MAUDU	J. MAUDU	22.01.2010			
REV	REVISION DESCRIPTION			BY	CHKD	AUTH	DATE		
AUTH:	S.A. CILLIERS	DATE:	MARCH 93	SCALE	 D-DT-3055			SAP No:	
CHKD:		DATE:		NTS				0229922	
				CAD REF:				0245950	
				SERIES 3000	SET	SHEET	REV		
DRAWN:	Z. WATSON	DATE:	14-09-92	FILE No:	9	7	24		
				3055					

Unique Identifier: 240-48887441



Revision 1

SPEC SHEET

SAP MATERIAL No.:	0670312						
SHORT DESCRIPTION:	BOX DISTR:POLETOP SPLIT METER 6-WAY 20A						
<p>TECH. DESCRIPTION:</p> <p>BOX, DISTRIBUTION: TYPE: POLETOP SPLIT METER 6-WAY 20A; WIDTH: 360 MM; LENGTH: 500 MM; DEPTH: 150 MM; MATERIAL: NON-METAL; PROVISION FOR THREE STAINLESS STEEL STRAPS 12MM WIDE X 0.75MM THICK FOR SECURING AROUND A POLE OR SQUARE POLE; SUPPLIED AND FITTED WITH:- 11 X NUMBER 1 HIGH STRENGTH COMPRESSION GLANDS, 4 X 1.5M X 16MM SQ. UV STABLE PVC INSULATED COPPER LEADS, 3 X 50A MINIATURE CIRCUIT BREAKERS (MCB) (D-DT 3083), 2 X NEUTRAL BUSBARS INTERNAL WIRING 2 X DIN RAILS FOR THE FITMENT OF THE MCBS AND METERS AND 3 X 5KA/5KV SURGE ARRESTORS; USED FOR 6 X 20 AMP CUSTOMERS; LAYOUT AND WIRING AS PER D-DT-1044; ESKOM DRAWING No. D-DT-3055 *</p>							
SAP MATERIAL No.:	0670315						
SHORT DESCRIPTION:	BOX DISTR:POLETOP SPLIT METER 6-WAY 60A						
<p>TECH. DESCRIPTION:</p> <p>BOX, DISTRIBUTION: TYPE: POLETOP SPLIT METER 6-WAY 60A; WIDTH: 360 MM; LENGTH: 500 MM; DEPTH: 150 MM; MATERIAL: NON-METAL; PROVISION FOR THREE STAINLESS STEEL STRAPS 12MM WIDE X 0.75MM THICK FOR SECURING AROUND A POLE OR SQUARE POLE; SUPPLIED AND FITTED WITH:- 13 X NUMBER 1 HIGH STRENGTH COMPRESSION GLANDS, 6 X 1.5M X 16MM SQ. UV STABLE PVC INSULATED COPPER LEADS, 6 X 63A MINIATURE CIRCUIT BREAKERS (MCB) (D-DT 3083), 2 X NEUTRAL BUSBARS INTERNAL WIRING 2 X DIN RAILS FOR THE FITMENT OF THE MCBS AND METERS AND 3 X 5KA/5KV SURGE ARRESTORS; USED FOR 6 X 60 AMP CUSTOMERS; LAYOUT AND WIRING AS PER D-DT-1044; ESKOM DRAWING No. D-DT-3055 *</p>							
24	DIMENSIONS ALLIGNED WITH DESIGN DRAWINGS		JS	H GROENEWALD	H GROENEWALD	18.08.2022	
23	NEW DESIGNS CREATED FOR SPLIT METER KIOSKS		JS	H GROENEWALD	H GROENEWALD	15.10.2021	
22	EXTERNAL TOGGLE LEVERS ADDED TO 120A PTB		P.A.T.	J. MAUDU	J. MAUDU	29.07.2015	
21	ESKOM SPEC. CORRECTED		P.A.T.	J. MAUDU	J. MAUDU	12.06.2014	
20	ALL SPLIT METERS NO. OF S.A.'S CHANGED		P.A.T.	J. MAUDU	J. MAUDU	22.01.2010	
REV	REVISION DESCRIPTION			BY	CHKD	AUTH	DATE
AUTH:	S.A. CILLIERS	DATE:	MARCH 93	SCALE	 <div style="display: flex; justify-content: space-between;"> <div> D-DT-3055 </div> <div> SAP No: 0670312 0670315 </div> </div>		
CHKD:		DATE:		NTS			
				CAD REF:			
				SERIES 3000	SET	SHEET	REV
DRAWN:	Z. WATSON	DATE:	14-09-92	FILE No:	9	8	24
				3055			

Unique Identifier: 240-48887441

SPEC SHEET

SAP MATERIAL No.:	0229921								
SHORT DESCRIPTION:	BOX DISTR:POLE TOP SPLIT METER 8-WAY 20A								
<p>TECH. DESCRIPTION:</p> <p>BOX, DISTRIBUTION: TYPE: POLE TOP SPLIT METER 8-WAY 20A;</p> <p>WIDTH: 360 MM; LENGTH: 500 MM; DEPTH: 150 MM;</p> <p>MATERIAL: NON-METAL; PROVISION FOR THREE STAINLESS STEEL STRAPS 12MM WIDE X 0.75MM THICK FOR SECURING AROUND A POLE OR SQUARE POLE;</p> <p>SUPPLIED AND FITTED WITH:- 13 X NUMBER 1 HIGH STRENGTH COMPRESSION GLANDS,</p> <p>4 X 1.5M X 16MM SQ. UV STABLE PVC INSULATED COPPER LEADS,</p> <p>4 X 50A MINIATURE CIRCUIT BREAKERS (MCB) (D-DT 3083),</p> <p>2 X NEUTRAL BUSBARS INTERNAL WIRING 2 X DIN RAILS FOR THE FITMENT OF THE MCBS AND METERS AND 2 X 5KA/5KV SURGE ARRESTORS; USED FOR 8 X 20 AMP CUSTOMERS;</p> <p>LAYOUT AND WIRING AS PER D-DT-1045;</p> <p>ESKOM DRAWING No. D-DT-3055 *</p>									
24	DIMENSIONS ALIGNED WITH DESIGN DRAWINGS			JS	H GROENEWALD	H GROENEWALD	18.08.2022		
23	NEW DESIGNS CREATED FOR SPLIT METER KIOSKS			JS	H GROENEWALD	H GROENEWALD	15.10.2021		
22	EXTERNAL TOGGLE LEVERS ADDED TO 120A PTB			P.A.T.	J. MAUDU	J. MAUDU	29.07.2015		
21	ESKOM SPEC. CORRECTED			P.A.T.	J. MAUDU	J. MAUDU	12.06.2014		
20	ALL SPLIT METERS NO. OF S.A.'S CHANGED			P.A.T.	J. MAUDU	J. MAUDU	22.01.2010		
REV	REVISION DESCRIPTION			BY	CHKD	AUTH	DATE	REF. DWGS	
AUTH:	S.A. CILLIERS	DATE:	MARCH 93	SCALE	 D-DT-3055		SAP No:		
CHKD:		DATE:		NTS			0229921		
				CAD REF:			SET	SHEET	REV
				SERIES 3000			9	9	24
DRAWN:	Z. WATSON	DATE:	14-09-92	FILE No:					
				3055					

Unique Identifier: 240-48887441

Revision 1