


LEGEND

- | | | |
|---|---|--|
| 1 UNIT COOLING PUMP SUCTION ISOL V/V | 22 CW TO AIR HEATER BEARING OIL COOLER ISOL V/V | 43 CW TO MILL A-E GB OIL COOLING INLET ISOL V/V |
| 2 UNIT COOLING PUMP SUCTION STRAINER | 23 CW TO ASH PLANT WEST MAIN ISOL V/V | 44 CW TO LH & RH ID FANS CPL OIL COOLER INLET ISOL V/V |
| 3 UNIT COOLING PUMP | 24 ASH PLANT SEALING WATER PUMPS SERVICE ISOL V/V | 45 CW FROM MILL A-E GB OIL COOLING OUTLET ISOL V/V |
| 4 UNIT COOLING PUMP DISCH. M/V | 25 SERVICE WATER BALANCE MAIN ISOL V/V | 46 CW FROM LH & RH FD FANS BEARING OUTLET V/V |
| 5 UNIT COOLING PUMP MOTORISED ISOL V/V | 26 CW RETURN SECTION ISOL V/V | 47 CW TO LH & RH FD BEARING INLET V/V |
| 6 BOILER COOLING WATER SUPPLY MAIN ISOL V/V | 27 CW RETURN ISOL V/V | 48 TO FOREBAY |
| 7 TURBINE COOLING WATER SUPPLY MAIN ISOL V/V | 28 CW TO COMP MAIN ISOL V/V | |
| 8 TURBINE COOLING WATER SUPPLY FLUSHING V/V | 29 CW TO AND FROM COMP M/V | |
| 9 EFP AND SFP CW DISTR MAIN ISOL V/V | 30 CW TO COMP AIR COOLER ISOL V/V | |
| 10 CW TO EFP MOTOR BEARINGS ISOL V/V | 31 COMP AIR COOLER CW OUTLET ISOL V/V | |
| 11 NOT IN USE | 32 CW TO COMP ISOL V/V | |
| 12 CW TO EFP BEARING OIL COOLER ISOL V/V | 33 COMP CW OUTLET ISOL V/V | |
| 13 CW TO BOILER PANEL INSTRUMENT ISOL V/V | 34 COMP CW RETURN MAIN ISOL V/V | |
| 14 CW TO LH AND RH FD FANS BEARING MAIN ISOL V/V | 35 BALANCE MAIN ISOL V/V | |
| 15 CW TO MILLS A-E GB OIL COOLING MAIN ISOL V/V | 36 CW BALANCE MAIN SECTION ISOL V/V | |
| 16 CW TO LH AND RH ID FANS BEARING MAIN ISOL V/V | 37 SERVICE WATER STRAINER | |
| 17 CW TO LH AND RH ID FANS CPL OIL COOLERS ISOL V/V | 38 SERVICE WATER FLOW METER ISOL V/V | |
| 18 CW TO ECON SAMPLING COOLER ISOL V/V | 39 SERVICE WATER FLOW METER BY-PASS V/V | |
| 19 CW PRESS TX ISOL V/V | 40 SERVICE WATER FLOW METER | |
| 20 CW MANIFOLD DRAIN AND FLUSHING V/V | 41 SERVICE WATER TO CW COMMON MAIN ISOL V/V | |
| 21 CW TO AIR HEATER MAIN ISOL V/V | 42 SERVICE WATER TO ABP SEALING SYSTEM ISOL V/V | |

SEE DRG. 0.36/1301

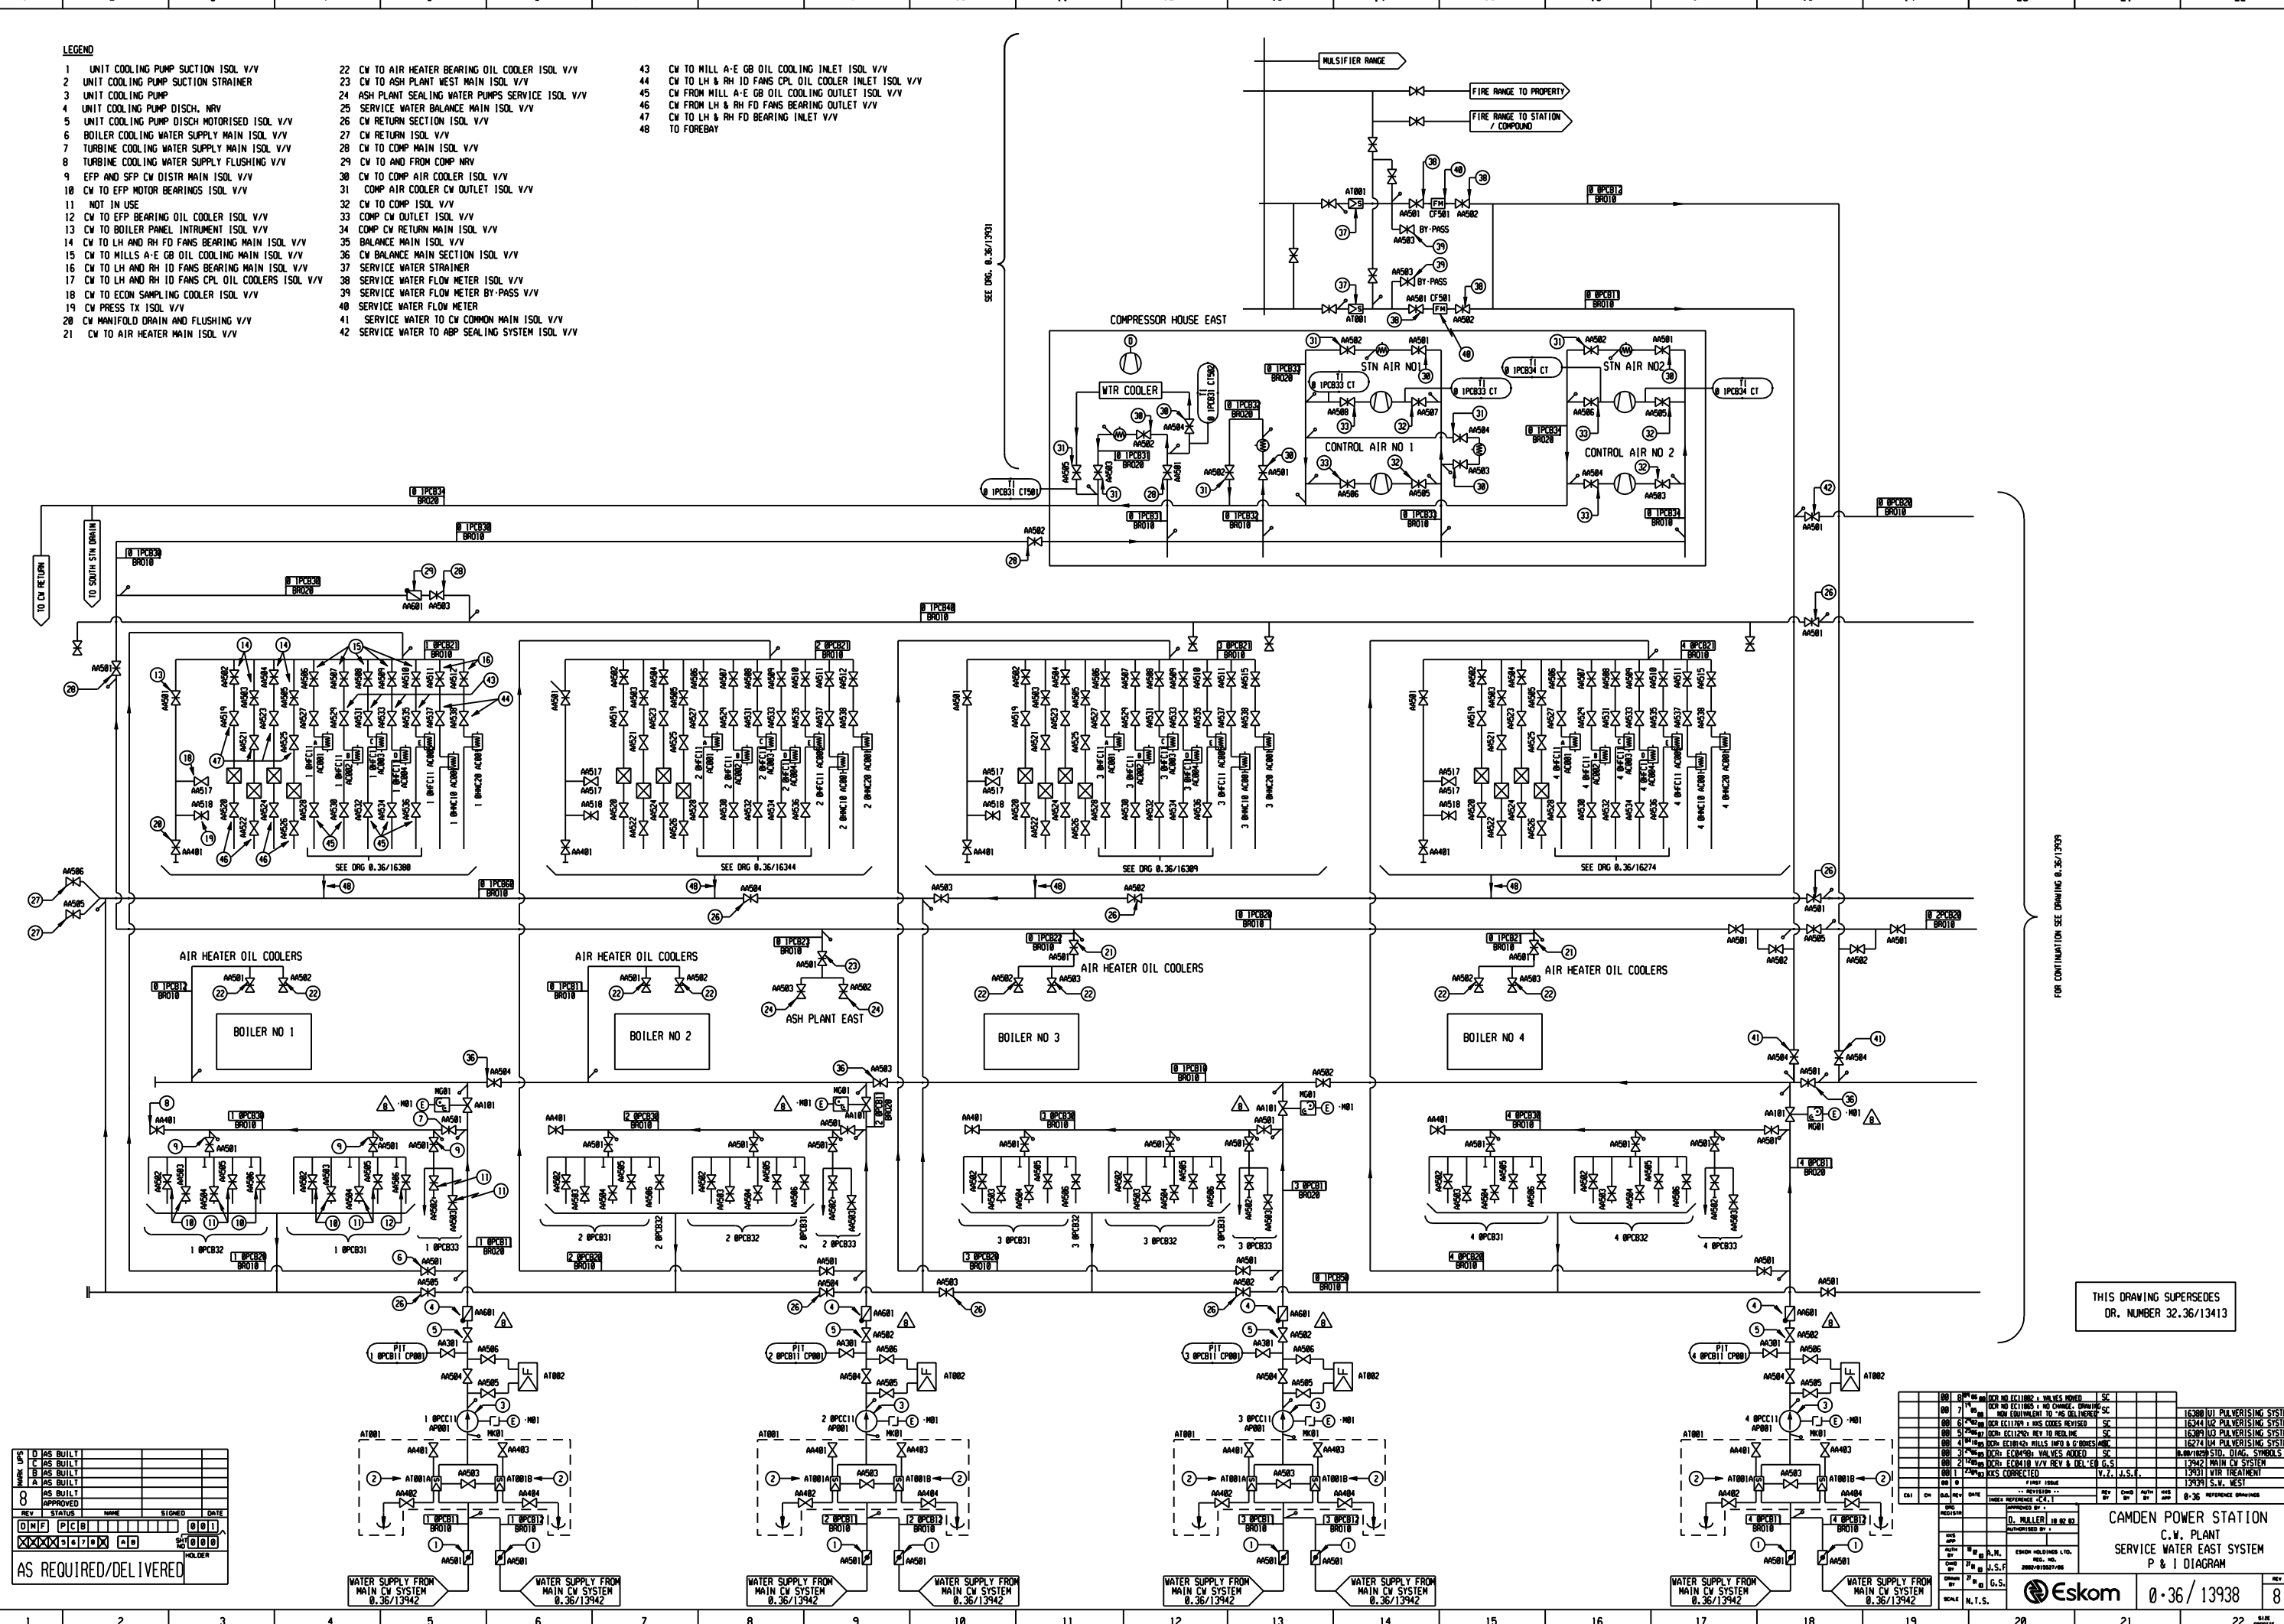

FOR CONTINUATION SEE DRAWING 0.36/1303

THIS DRAWING SUPERSEDES
DR. NUMBER 32.36/13413

REV	STATUS	DATE	BY	CHKD	APPROVED

AS REQUIRED/DELIVERED

NO	DATE	DESCRIPTION	BY	CHKD	APPROVED
00	01/01/00	ISSUED FOR CONSTRUCTION			
01	01/01/00	REVISED TO INCLUDE CHANGES			
02	01/01/00	REVISED TO INCLUDE CHANGES			
03	01/01/00	REVISED TO INCLUDE CHANGES			
04	01/01/00	REVISED TO INCLUDE CHANGES			
05	01/01/00	REVISED TO INCLUDE CHANGES			
06	01/01/00	REVISED TO INCLUDE CHANGES			
07	01/01/00	REVISED TO INCLUDE CHANGES			
08	01/01/00	REVISED TO INCLUDE CHANGES			
09	01/01/00	REVISED TO INCLUDE CHANGES			
10	01/01/00	REVISED TO INCLUDE CHANGES			
11	01/01/00	REVISED TO INCLUDE CHANGES			
12	01/01/00	REVISED TO INCLUDE CHANGES			
13	01/01/00	REVISED TO INCLUDE CHANGES			
14	01/01/00	REVISED TO INCLUDE CHANGES			
15	01/01/00	REVISED TO INCLUDE CHANGES			
16	01/01/00	REVISED TO INCLUDE CHANGES			
17	01/01/00	REVISED TO INCLUDE CHANGES			
18	01/01/00	REVISED TO INCLUDE CHANGES			
19	01/01/00	REVISED TO INCLUDE CHANGES			
20	01/01/00	REVISED TO INCLUDE CHANGES			
21	01/01/00	REVISED TO INCLUDE CHANGES			
22	01/01/00	REVISED TO INCLUDE CHANGES			

Camden Power Station
 C.W. PLANT
 SERVICE WATER EAST SYSTEM
 P & I DIAGRAM

Eskom
 0.36/13938