


NOTES

- 1: COMPONENTS INSTALLED IN BOX FITTED WITH LARGE POLE MOUNTING BRACKET
- 2: WIND STRAP TO BE FITTED TO DOOR
- 3: ALL CABLE ENTRIES TO BE FITTED WITH APPROVED COMPRESSION GLANDS
- 4: * = MINIMUM OPENING WITH DOOR OPEN

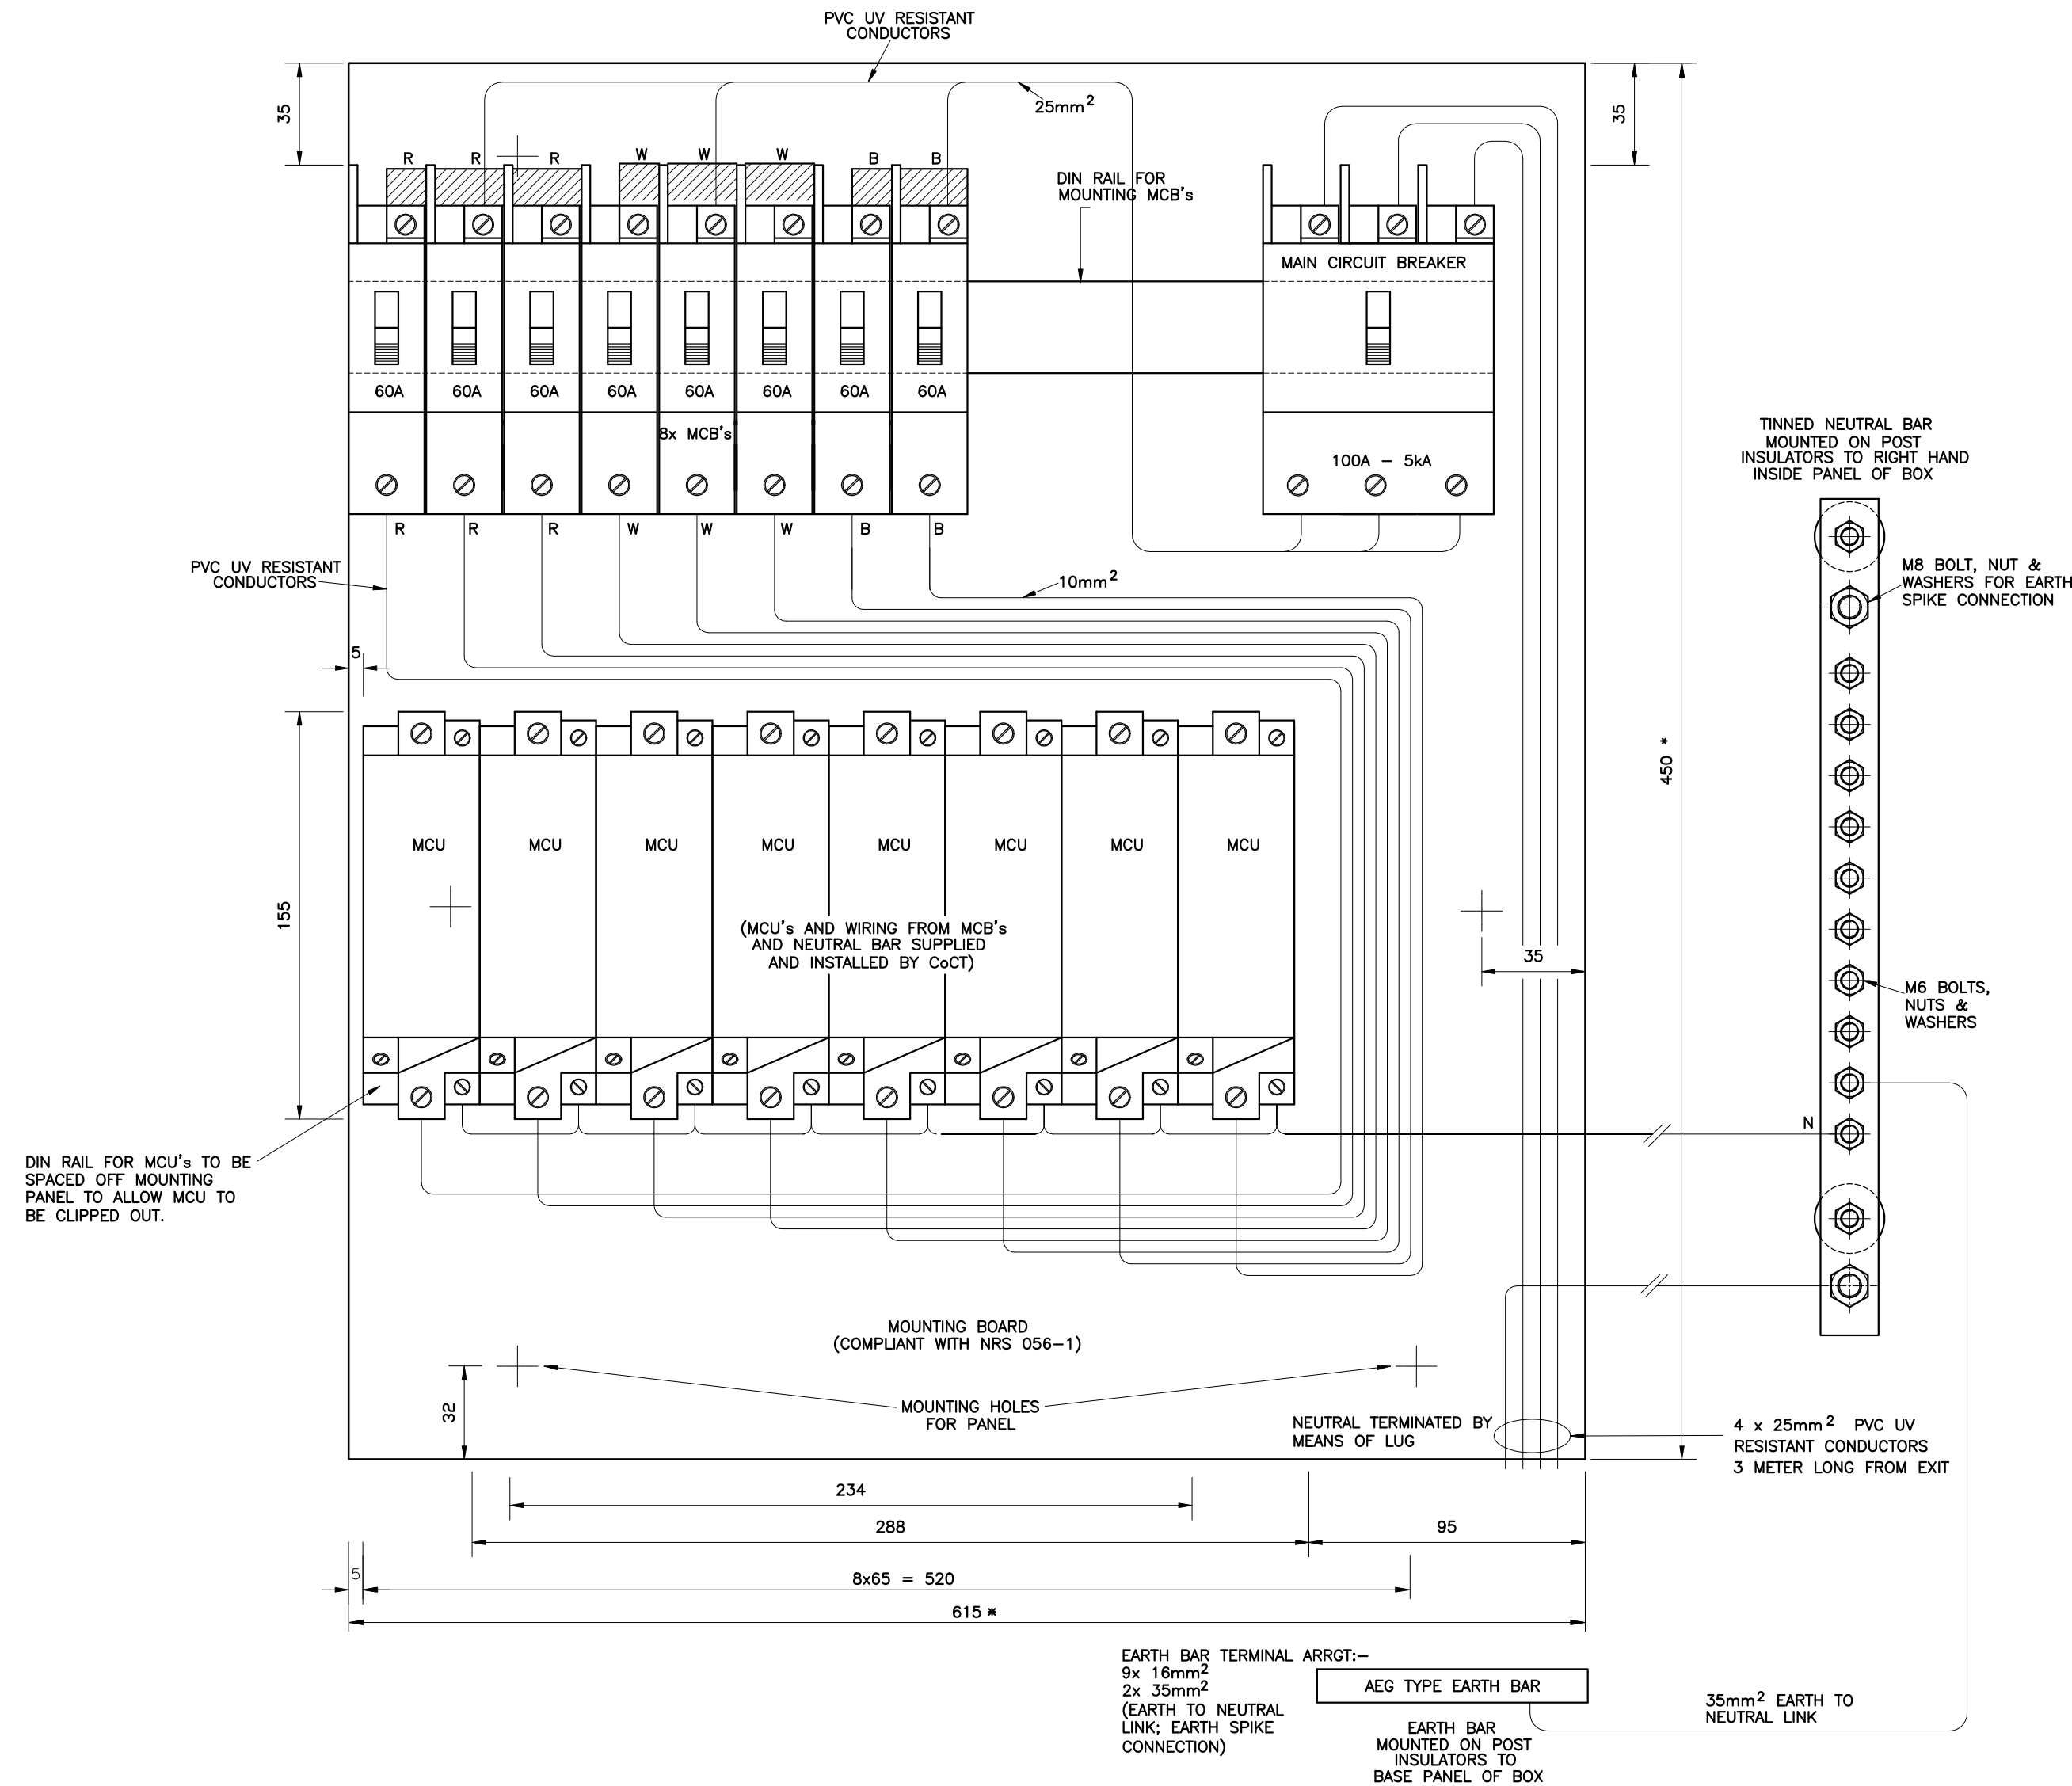

MANUFACTURING DRAWING

THE COPYRIGHT OF THIS PLAN AND DESIGN RESIDES WITH THE CITY OF CAPE TOWN AND MAY NOT BE REPRODUCE ISSUED OR USED FOR ANY PURPOSE OTHER THAN IT WAS INTENDED FOR ORIGINALLY



CITY OF CAPE TOWN
ISIXEKO SASEKAPA
STAD KAAPSTAD

ENERGY DIRECTORATE
SPACIAL DATA SERVICES
ARCHITECTURAL/MECHANICAL SECTION
HEAD OFFICE BLOEMHOF ROAD
BELLVILLE, PRIVATE BAG X44 7535

DIRECTOR: ELECTRICITY	E. CAPES
MANAGER: ENGINEERING	J. VAN DER MERWE
CO-ORDINATOR SDS	G. HECTOR

PROJECT TITLE	8 WAY POLE MOUNTED SERVICE DISTRIBUTION BOX TYPICAL LAYOUT (WIRING INCLUDED)
---------------	---

APPROVED BY:	CHECKED	
COMPILED: A. HALL		
SCALE: N.T.S.	DATE: 2008/02/21	
DRAWING No. DR 3164	SHEET 1	REVISION No. 9
		SHEET SIZE A2