



NOTES


SEE SHEET 1 FOR MAIN BOX LAYOUT.

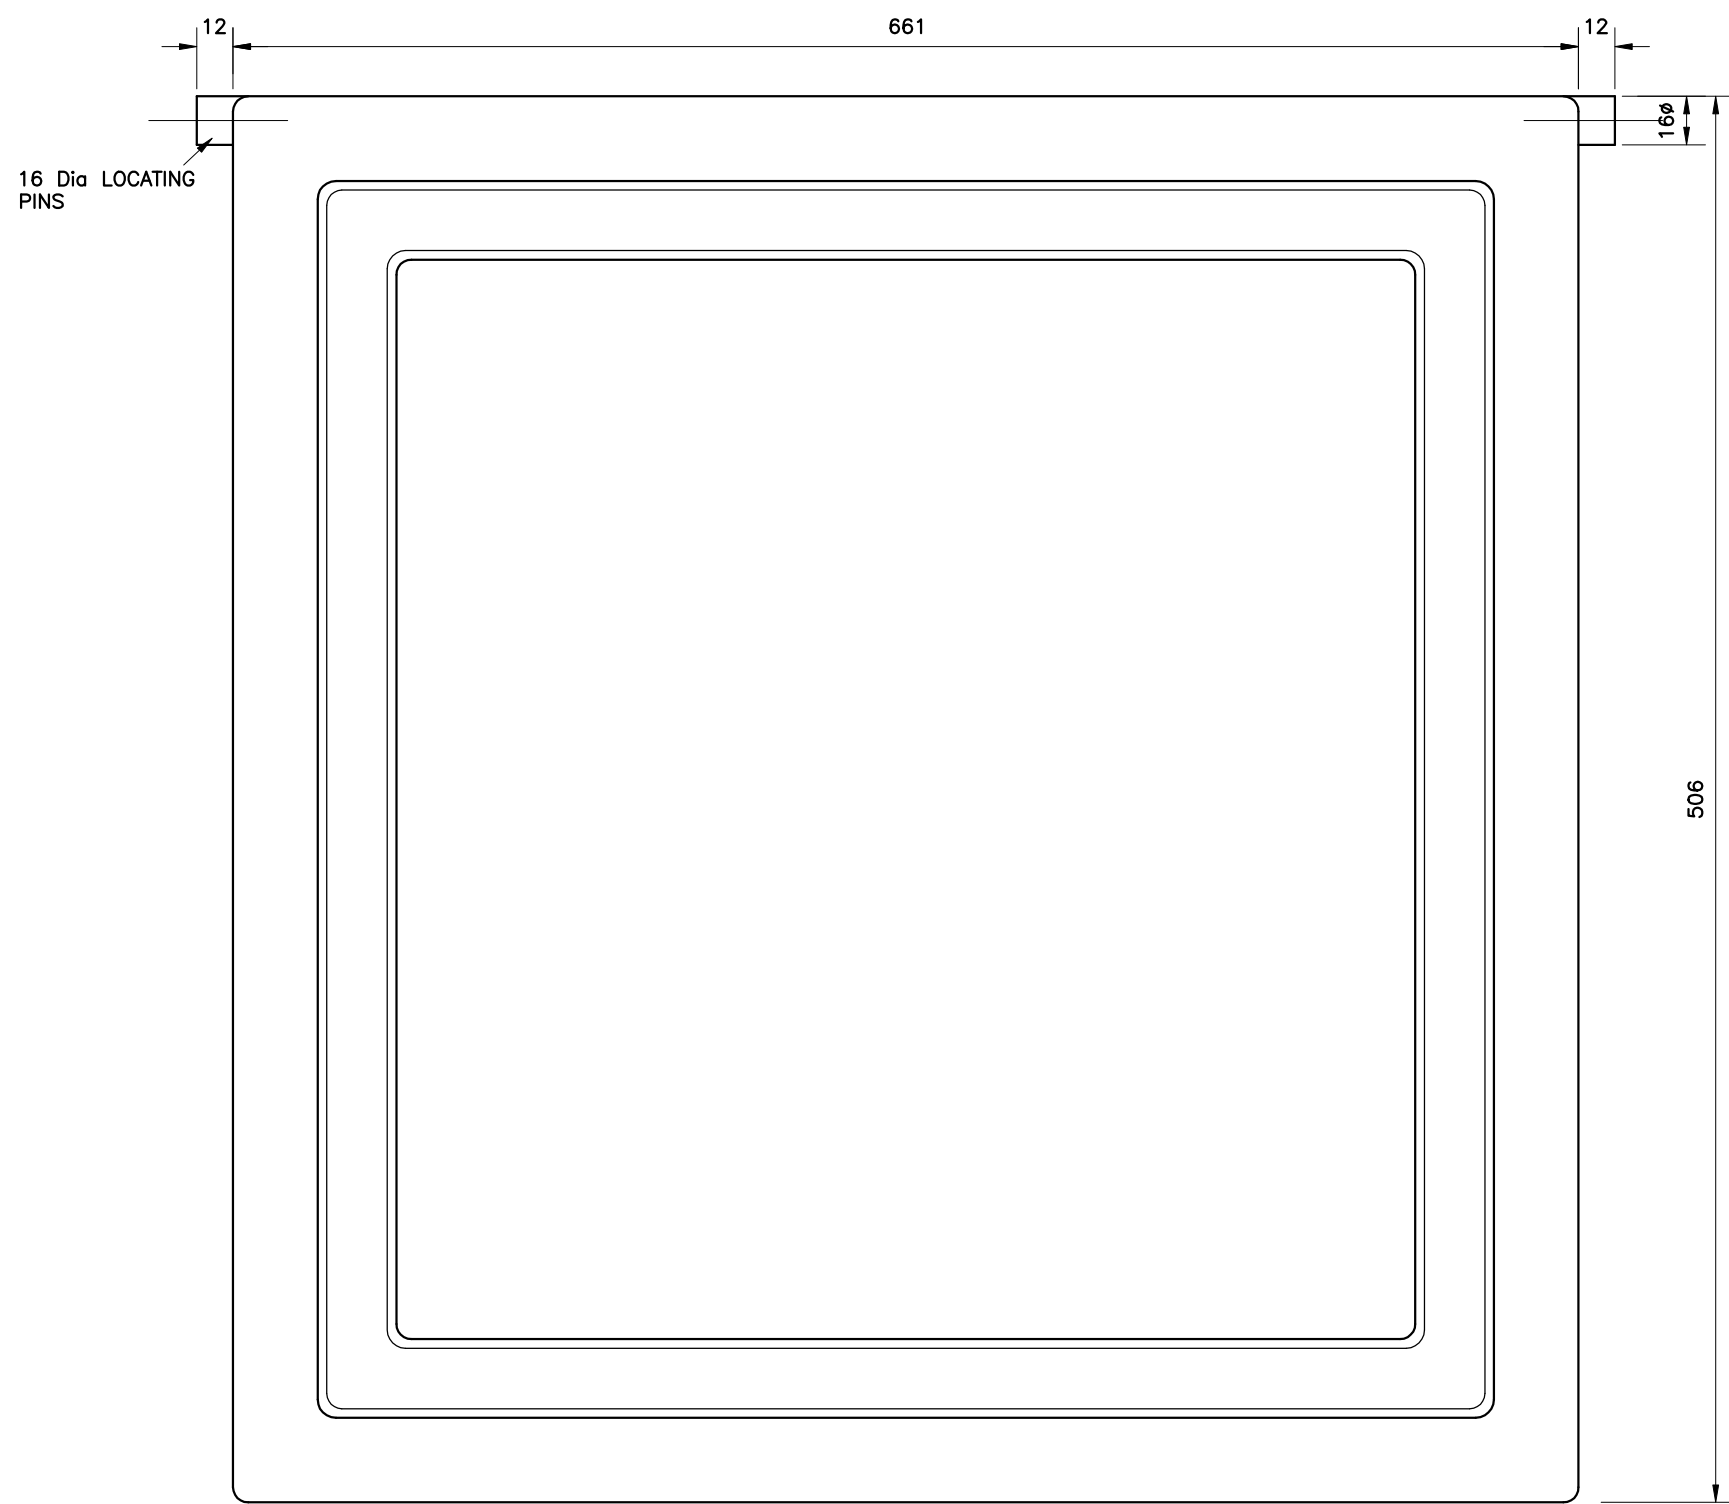


COVER REAR VIEW
SCALE: 1:2,5
MATERIAL: 3mm THICK POLYETHYLENE POLYMER

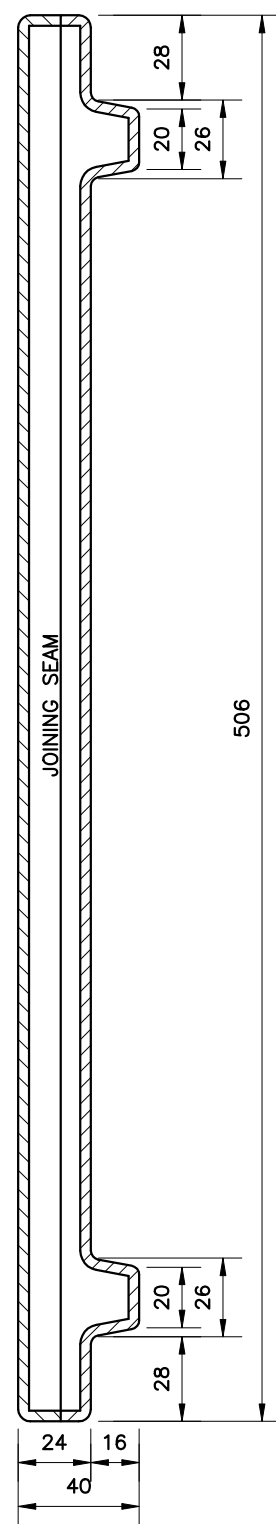

SECTION THROUGH COVER
SCALE: 1:2,5
MATERIAL: 3mm THICK POLYETHYLENE POLYMER

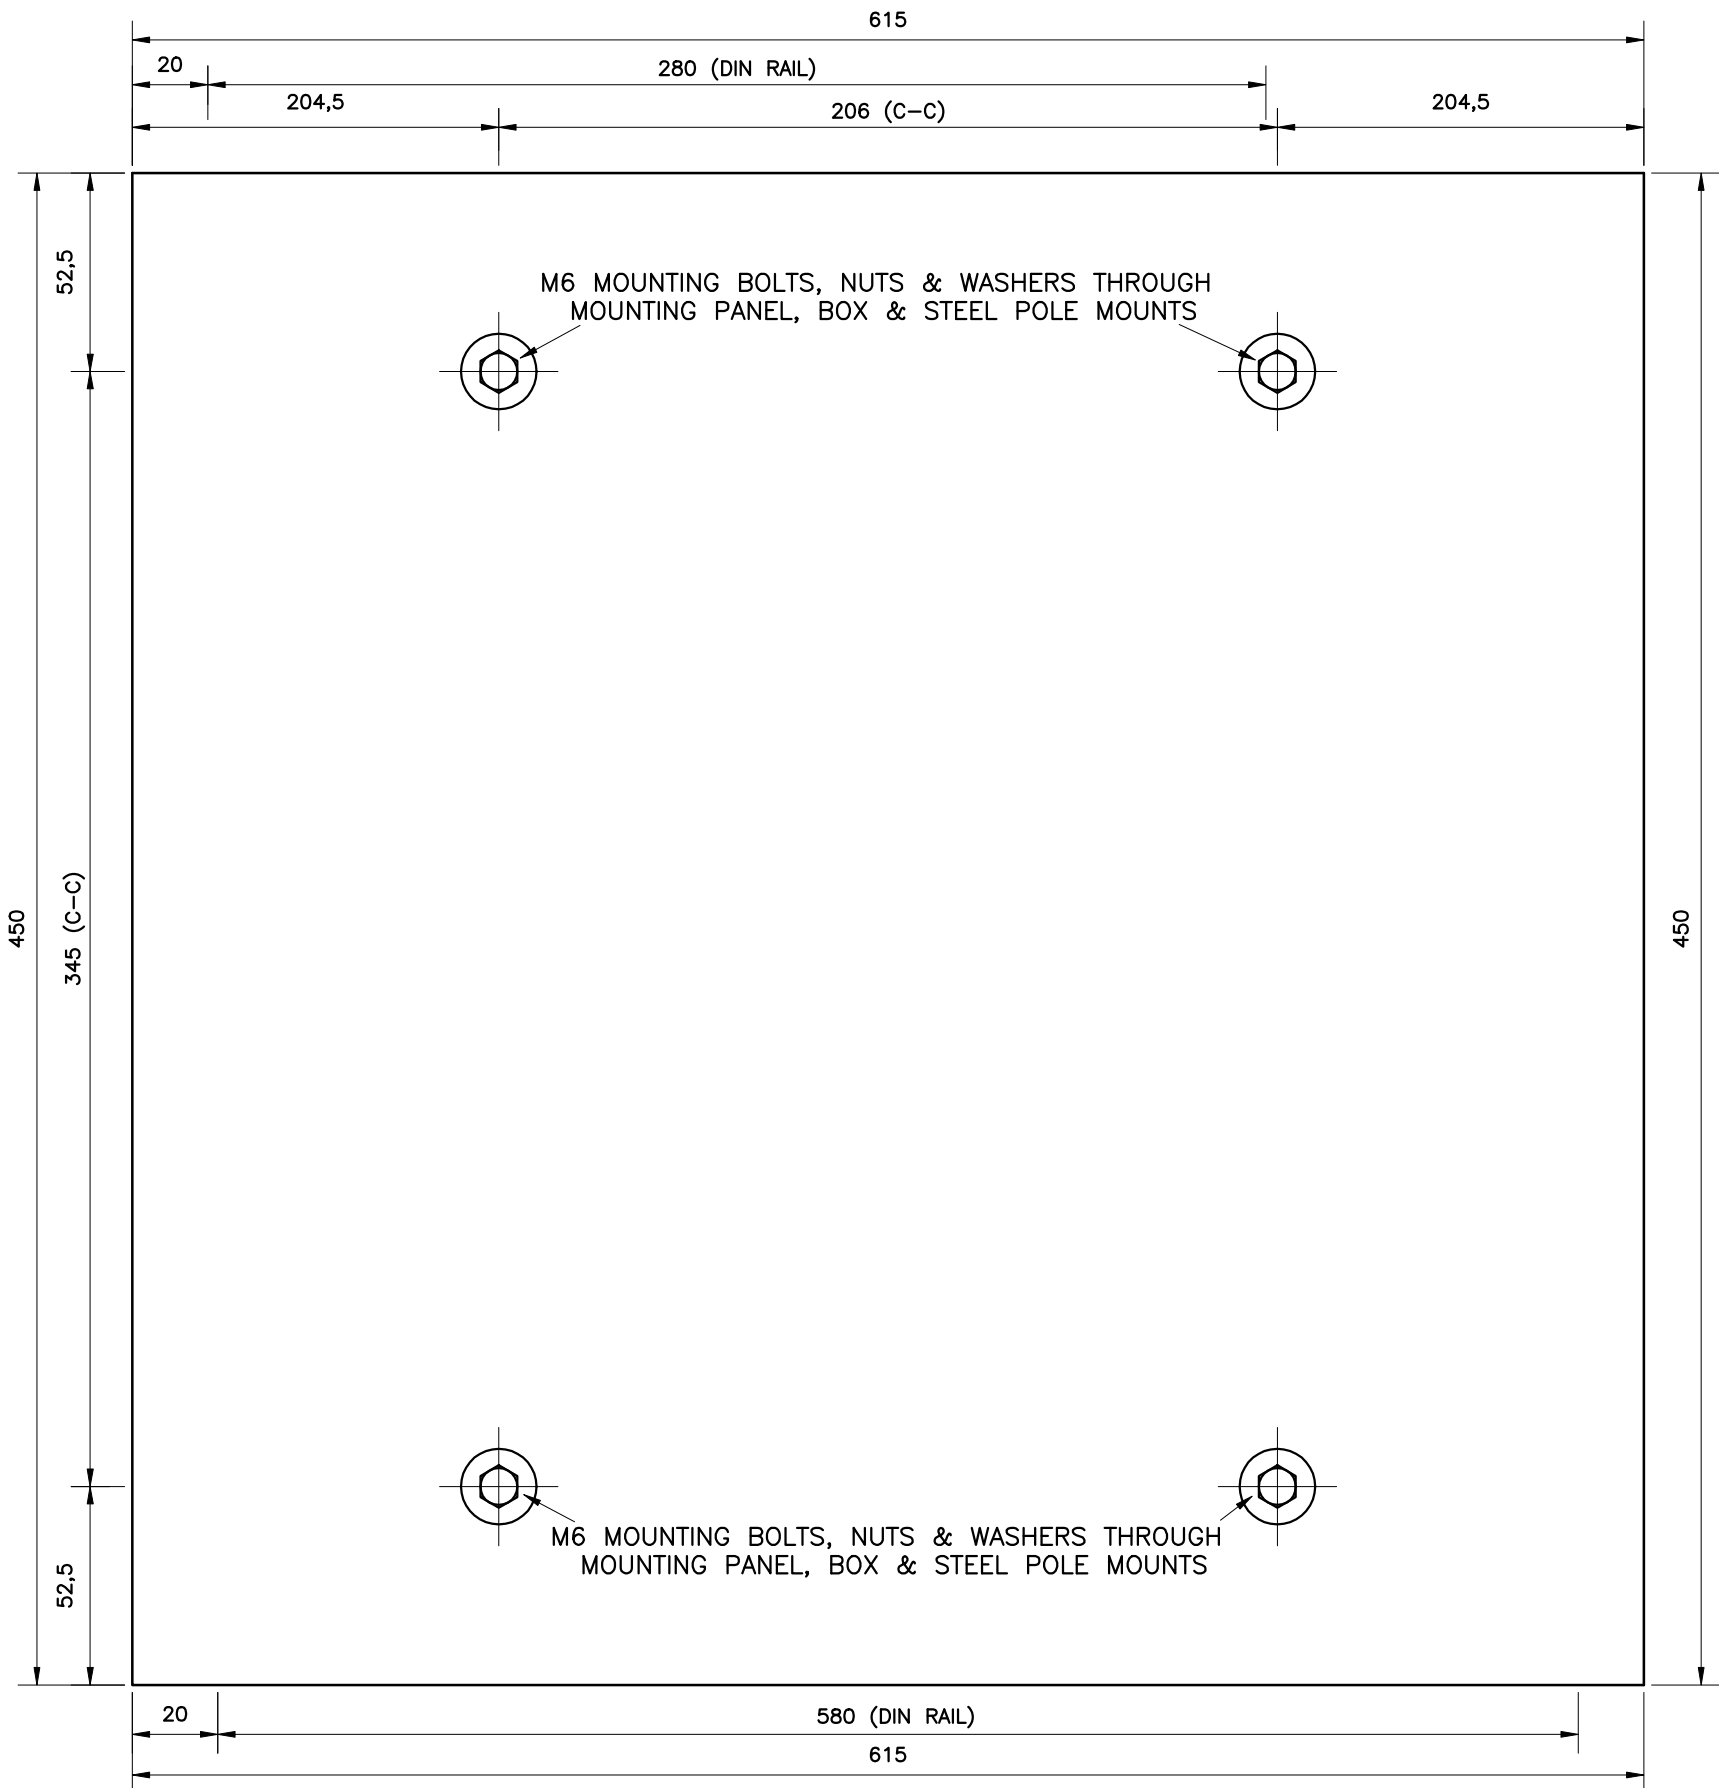


BOARD LAYOUT
SCALE: 1:2
MATERIAL: COMPLIANT WITH NRS 056-1

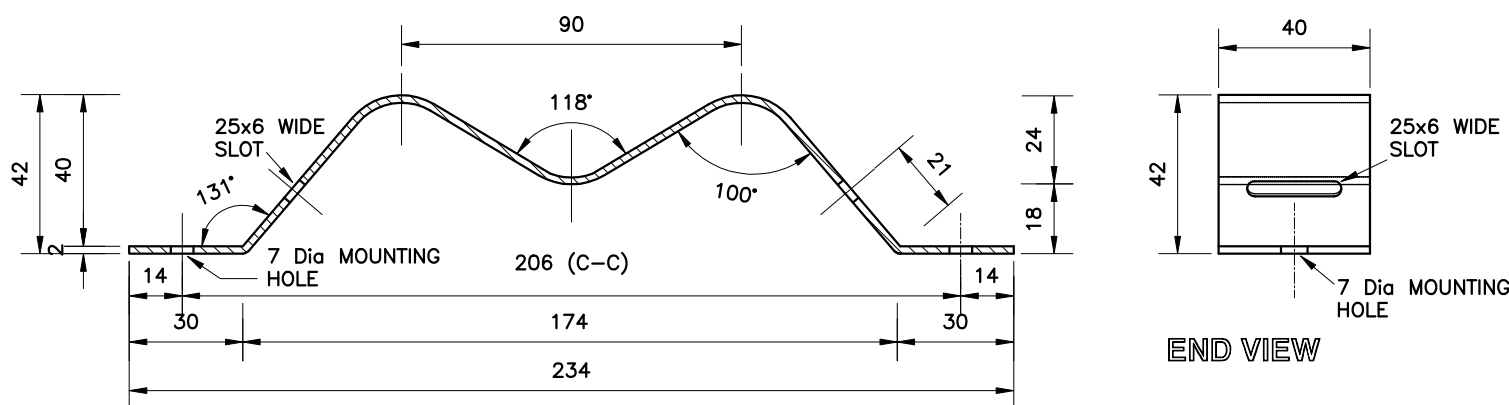


SECTIONAL SIDE VIEW

END VIEW

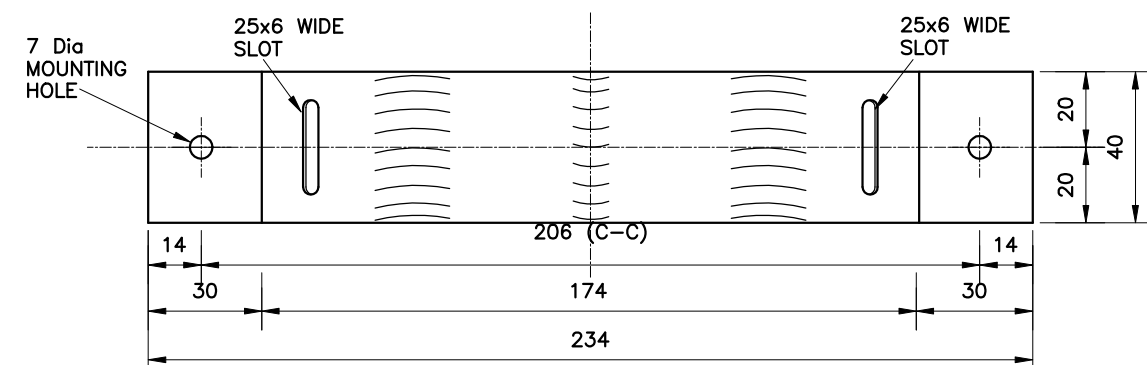

TOP VIEW

BOX MOUNTING BRACKET
SCALE: 1:2
MATERIAL: 2mm THICK 3CR12 STAINLESS STEEL

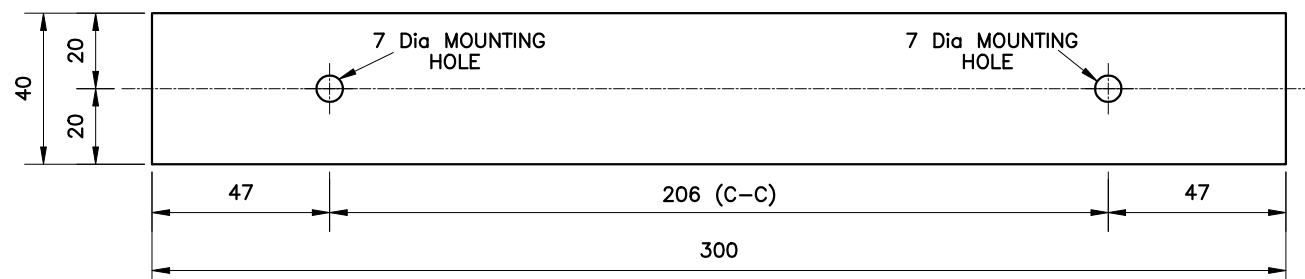

BRACE DETAIL
SCALE: 1:2
MATERIAL: 2mm THICK 3CR12 STAINLESS STEEL

- REVISION 5:- A.HALL - 2026/04/10
MOUNTING PANEL (COMPLIANT WITH NRS 056-1)
- REVISION 4:- A.HALL - 2023/09/28
DIMENSIONS CHANGED.
- REVISION 3:- A.HALL - 2020/06/22
DIMENSIONS CHANGED, BRACE DETAIL ADDED, TITLE UPDATED.
- REVISION 2:- A.HALL - 2017/03/28
DOOR LOCKING STAPLE REMOVED FROM BOX
- REVISION 1:- A.HALL - 2016/10/17
CIRCUIT BREAKERS, ENERGY DISPENSER LAYOUT REMOVED FROM BOARD LAYOUT.

MANUFACTURING DRAWING

THE COPYRIGHT OF THIS PLAN AND DESIGN RESIDES WITH THE CITY OF CAPE TOWN AND
MAY NOT BE REPRODUCE ISSUED OR USED FOR ANY PURPOSE OTHER
THAN IT WAS INTENDED FOR ORIGINALLY



CITY OF CAPE TOWN
ISIXEKO SASEKAPA
STAD KAAPSTAD

**ENERGY
DIRECTORATE**

SPACIAL DATA SERVICES
ARCHITECTURAL/MECHANICAL SECTION
HEAD OFFICE BLOEMHOF ROAD
BELLVILLE, PRIVATE BAG X44 7535

DIRECTOR: ELECTRICITY GENERATION & DISTRIBUTION	E. CAPE
MANAGER: ENGINEERING	J. VAN DER MERWE
CO-ORDINATOR SDS	G. HECTOR

PROJECT TITLE
**8- WAY POLYETHYLENE POLE MOUNTED
SERVICE DISTRIBUTION BOX
DETAIL SHEET**

APPROVED BY:	CHECKED	
COMPILED: A. HALL		
SCALE: AS SHOWN	DATE: 2011/11/04	
DRAWING No. DR 3326	SHEET 2 OF 2	REVISION No. 5
		SHEET SIZE A1