


# NOTES

- 1: COMPONENTS INSTALLED IN BOX FITTED WITH LARGE POLE MOUNTING BRACKET
- 2: WIND STRAP TO BE FITTED TO DOOR
- 3: ALL CABLE ENTRIES TO BE FITTED WITH APPROVED COMPRESSION GLANDS
- 4: \* = MINIMUM OPENING WITH DOOR OPEN

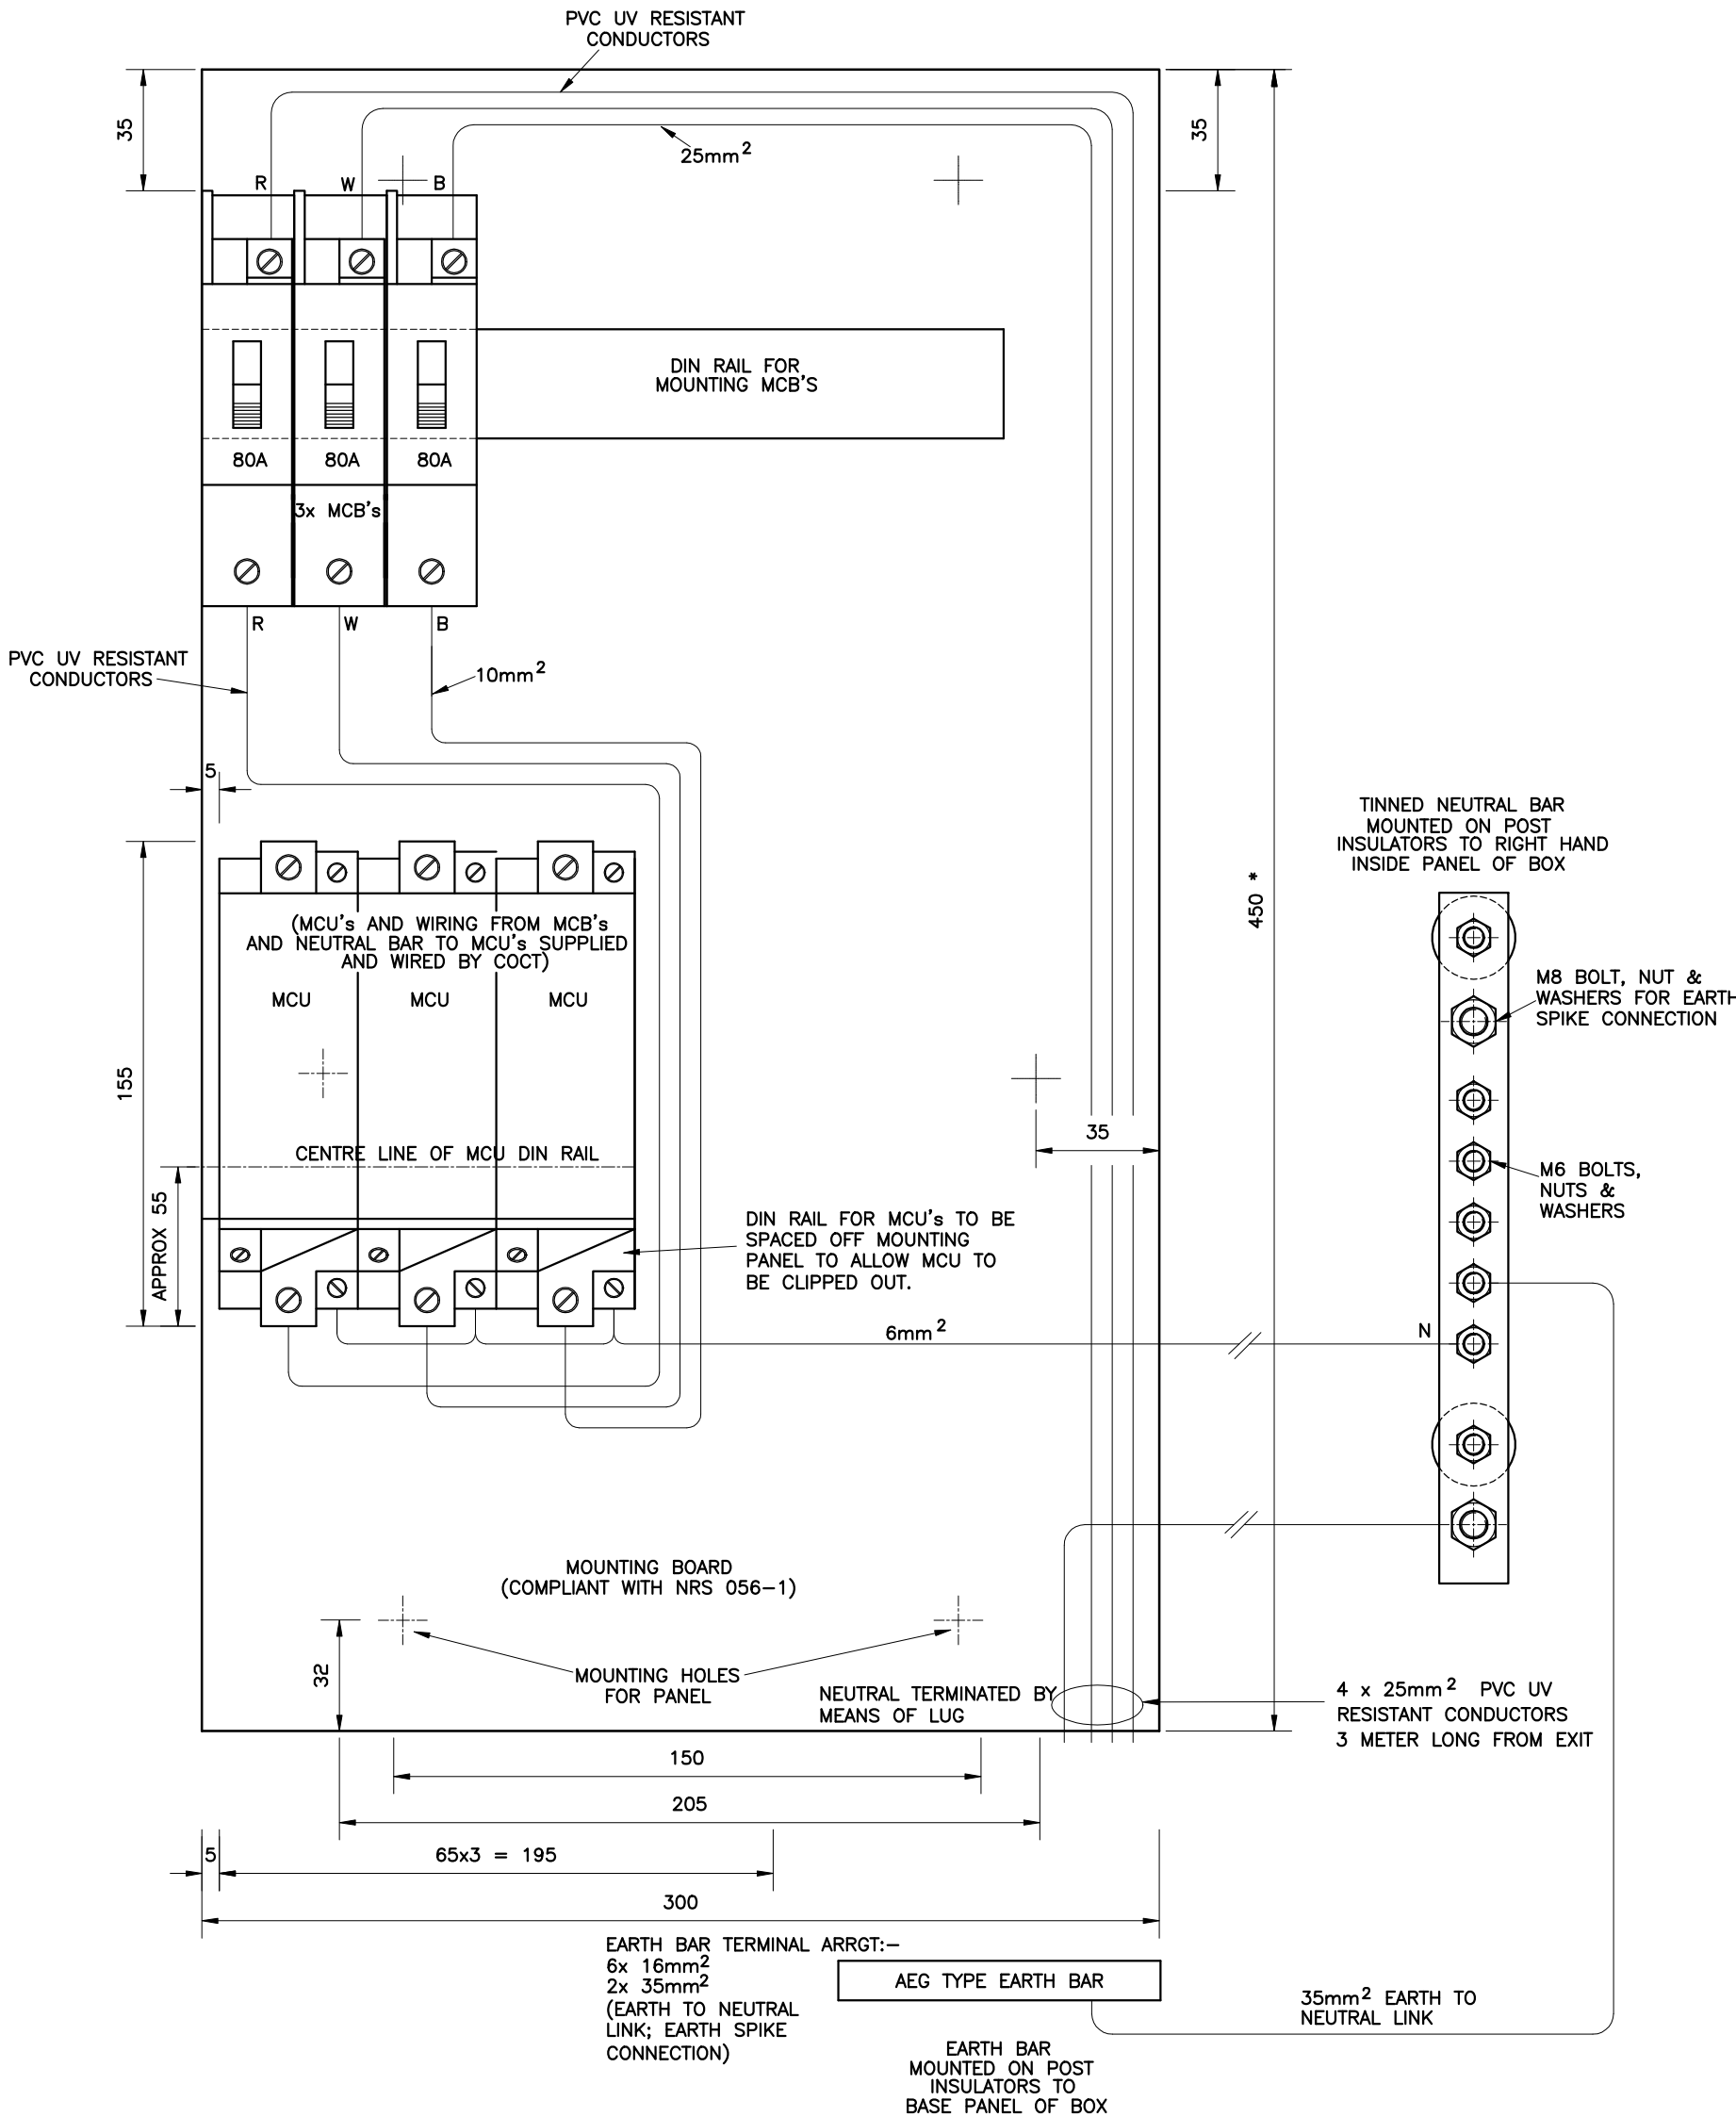

# MANUFACTURING DRAWING

**THE COPYRIGHT OF THIS PLAN AND DESIGN RESIDES WITH THE CITY OF CAPE TOWN AND  
MAY NOT BE REPRODUCE ISSUED OR USED FOR ANY PURPOSE OTHER  
THAN IT WAS INTENDED FOR ORIGINALLY**



**ENERGY  
DIRECTORATE**

**SPECIAL DATA SERVICES**  
ARCHITECTURAL/MECHANICAL SECTION  
HEAD OFFICE BLOEMHOF ROAD  
BELLVILLE, PRIVATE BAG X44 7535

<b>DIRECTOR: ELECTRICITY</b>	<b>E. CAPES</b>
<b>MANAGER: ENGINEERING</b>	<b>J. VAN DER MERWE</b>
<b>CO-ORDINATOR SDS</b>	<b>G. HECTOR</b>

**PROJECT TITLE**

### 80A 3 WAY POLE MOUNTED SERVICE DISTRIBUTION BOX TYPICAL LAYOUT

			CHECKED		
APPROVED BY: .....					
COMPILED: A. HALL					
SCALE: N.T.S.		DATE:	2017/04/23		
DRAWING No.			SHEET	REVISION No.	SHEET SIZE
DR 3372			1	3	A2