


NOTES

- 1: COMPONENTS INSTALLED IN BOX FITTED WITH LARGE POLE MOUNTING BRACKET
- 2: WIND STRAP TO BE FITTED TO DOOR
- 3: ALL CABLE ENTRIES TO BE FITTED WITH APPROVED COMPRESSION GLANDS
- 4: \* = MINIMUM OPENING WITH DOOR OPEN

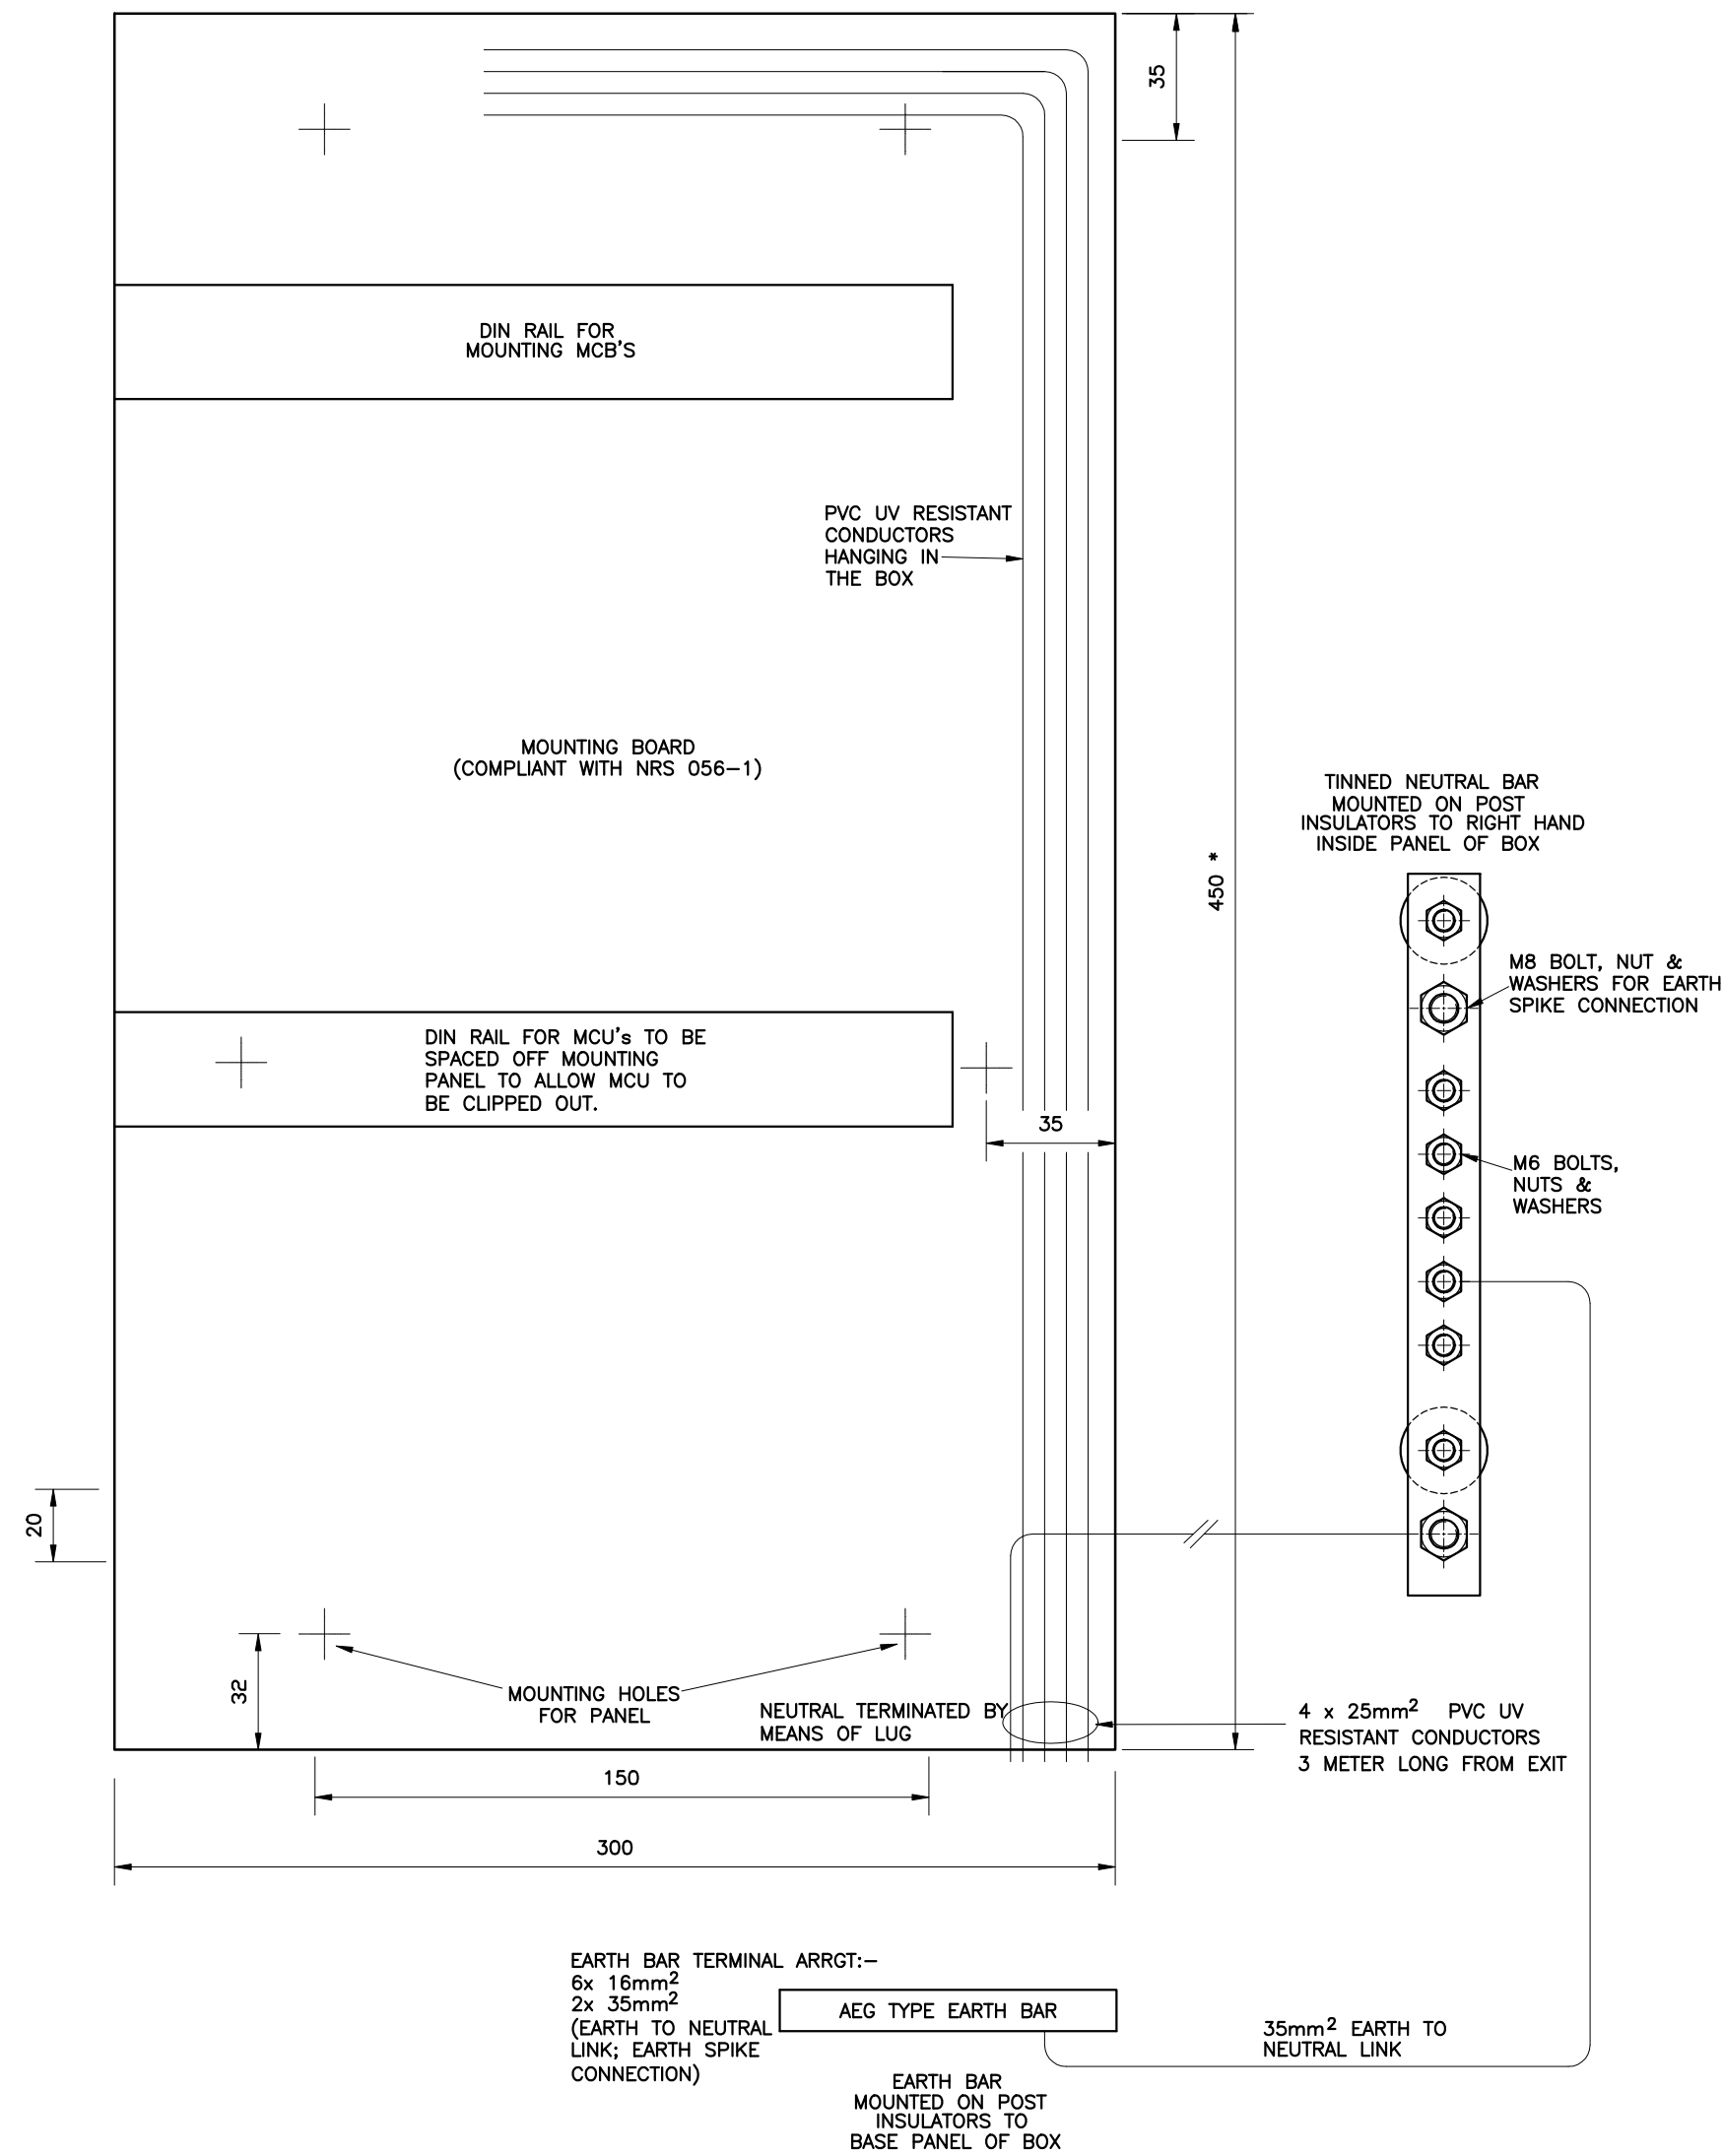

REV 3:- 14/04/2026 A.E.HALL  
MOUNTING PANEL (COMPLIANT WITH NRS 056-1)  
TAIL LENGTH CHANGED 3m FROM EXIT

REV 2:- 18/08/2023  
EARTH & NEUTRAL BAR RE-LOCATED & FIXED TO BOX AS INDICATED.

REV 1:- 22/06/2020  
DIMENSIONS CHANGED, EARTH BAR RE-LOCATED.

MANUFACTURING DRAWING

THE COPYRIGHT OF THIS PLAN AND DESIGN RESIDES WITH THE CITY OF CAPE TOWN AND MAY NOT BE REPRODUCE ISSUED OR USED FOR ANY PURPOSE OTHER THAN IT WAS INTENDED FOR ORIGINALLY



CITY OF CAPE TOWN  
ISIXEKO SASEKAPA  
STAD KAAPSTAD

**ENERGY  
DIRECTORATE**

**SPACIAL DATA SERVICES**

ARCHITECTURAL/MECHANICAL SECTION  
HEAD OFFICE BLOEMHOF ROAD  
BELLVILLE, PRIVATE BAG X44 7535

DIRECTOR: ELECTRICITY	E. CAPES
MANAGER: ENGINEERING	J. VAN DER MERWE
CO-ORDINATOR SDS	G. HECTOR

PROJECT TITLE

**BACKYARDER'S  
EMPTY POLE MOUNTED  
SERVICE DISTRIBUTION BOX  
TYPICAL LAYOUT**

APPROVED BY: .....	CHECKED	
COMPILED: A. HALL		
SCALE: N.T.S.	DATE: 2017/01/23	
DRAWING No. <b>DR 3374</b>	SHEET <b>1</b>	REVISION No. <b>3</b>
		SHEET SIZE <b>A2</b>