




SECTIONAL VIEW
SCALE 1:25

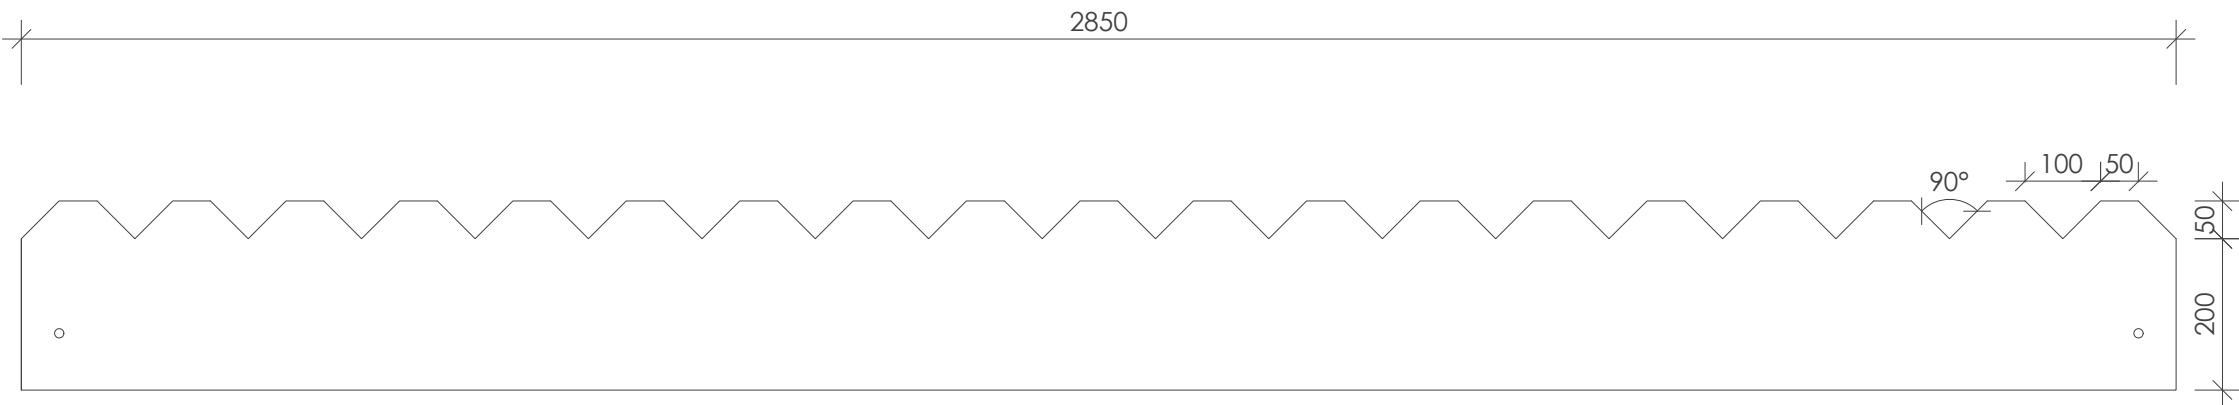

V-NOTCH WEIR DETAIL
SCALE 1:10

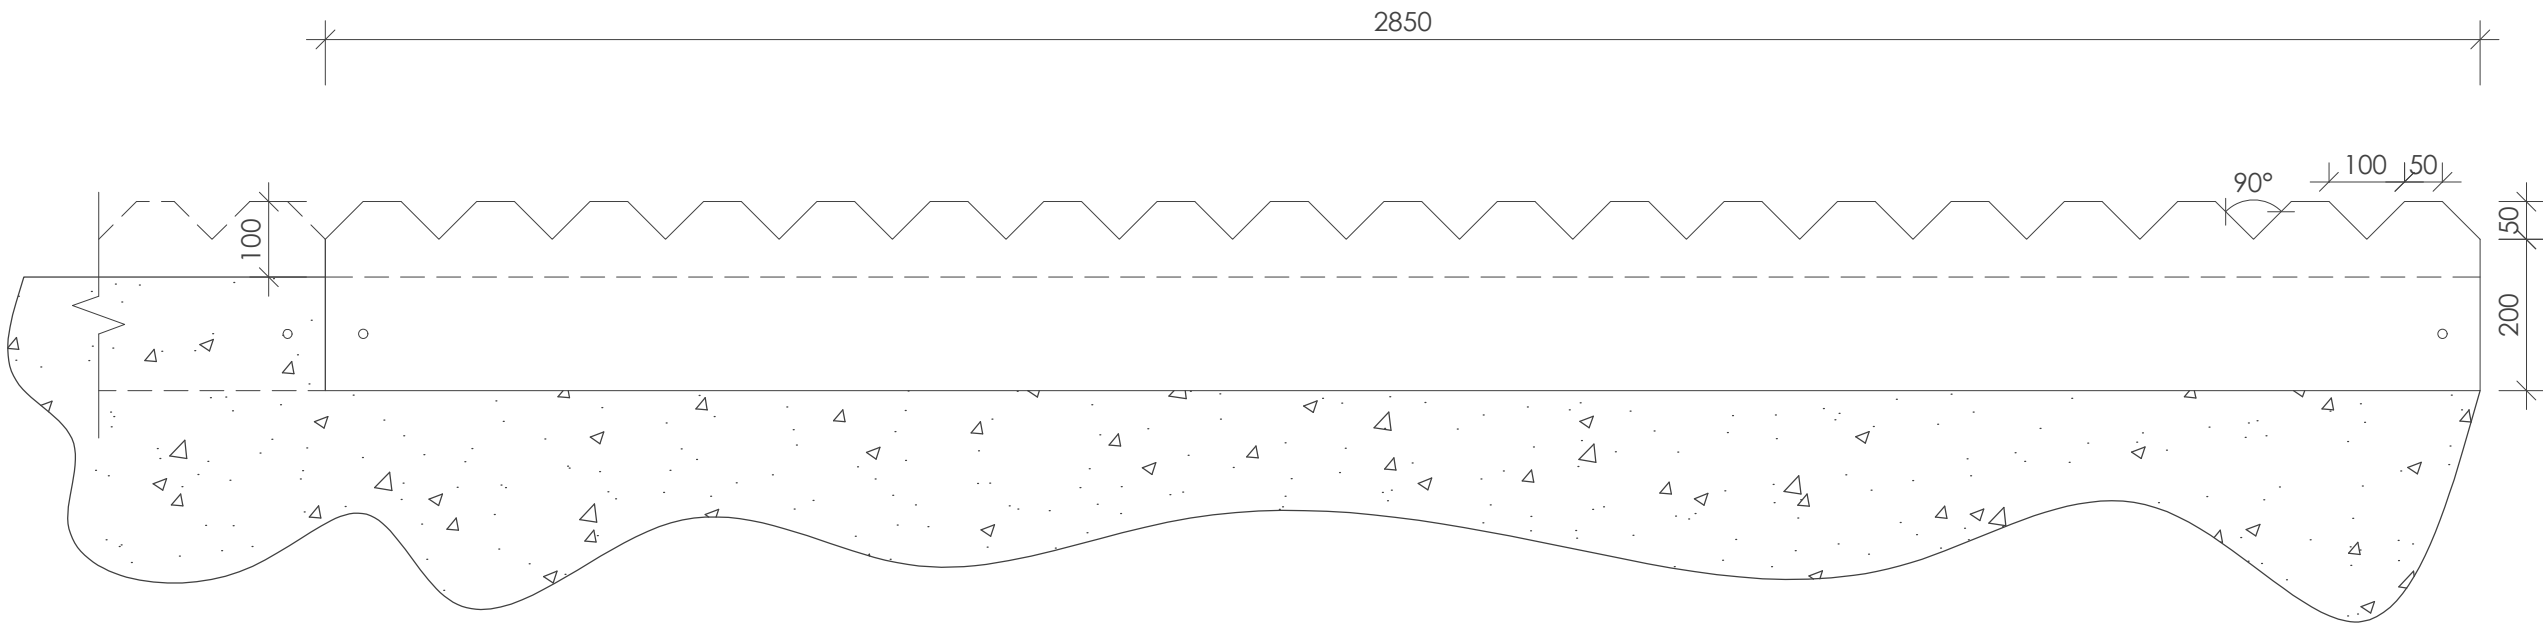

MOUNTING DETAIL
SCALE 1:10

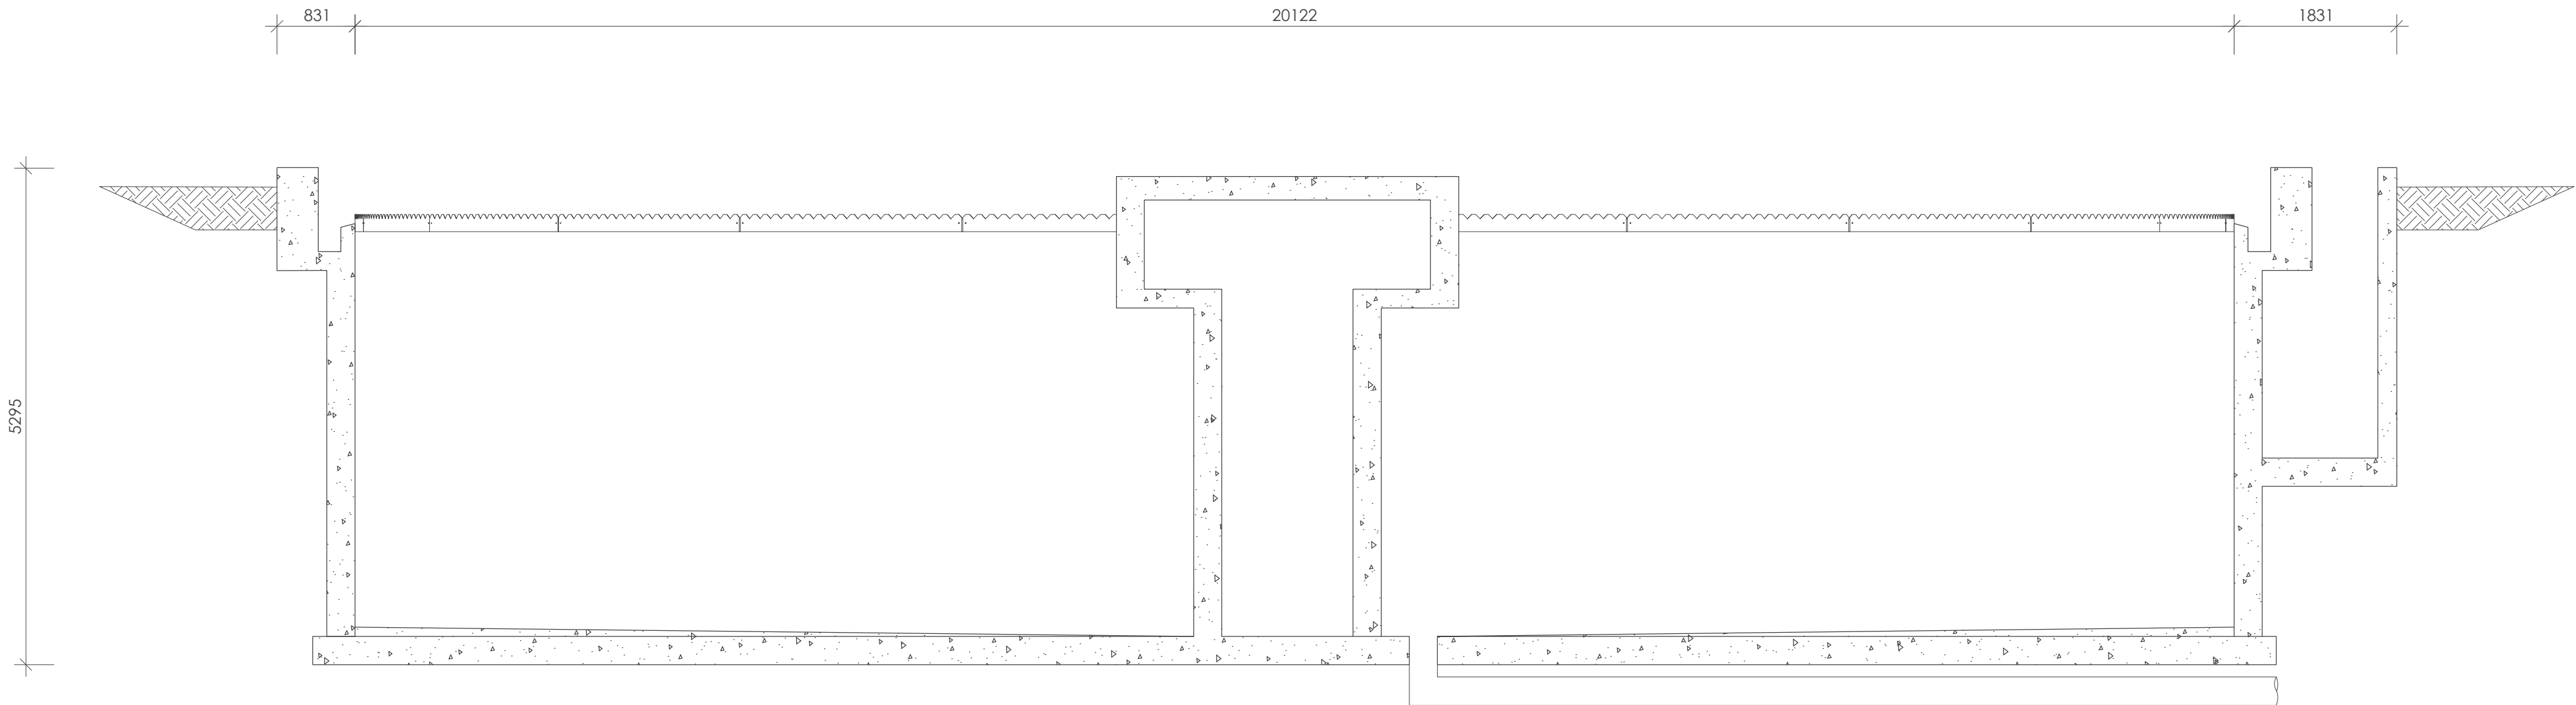

SECTIONAL VIEW
SCALE 1:50

V-NOTCH WEIR	
SPECIFICATION	DESCRIPTION & DIMENSIONS (mm)
MATERIAL	SS 304
THICKNESS	3
LENGHT	2850,0
HEIGHT	250
V HEIGHT	50
V WIDTH	100
ANGLE (DEGREES)	90

- NOTES:
- EXISTING BOLTS IN CLARIFIER TO BE USE BY CONTRACTOR FOR MOUNTING OF WEIR



ISSUED FOR TENDER

0 50

100 MILLIMETRES ON ORIGINAL DRAWING

(A) BEFORE CONTRACT COMMENCES

(A) AFTER CONSTRUCTION CONTRACT HAS COMMENCED

Nr.	DATE	AMENDMENTS

COPYRIGHT IS VESTED IN V3 CONSULTING ENGINEERS
IN TERMS OF THE COPYRIGHT ACT (ACT 98 OF 1978)

CLIENT / IMPLEMENTING AGENT

vaal central water.naturally

V3 CONSULTING ENGINEERS

T: +27 51 045 1950

Suite 31, Nobel House, 196 Nelson Mandela Road, Brandwag, Bloemfontein, 9301

CE



PROJECT

TSHIAME WWTW REFURBISHMENT

DRAWING DESCRIPTION

SECONDARY SETTLING TANK V-NOTCH WEIR

DRAWING NO.	REVISION
10909001-6007	T1

DESIGNED:	AK	CHECKED:	
DRAWN:	EMT	SCALE:	AS SHOWN A1
APPROVED:		INCEPTION DATE:	SEPT24
FILE PATH:	SHAREPOINT / BLOEMFONTEIN - 10909001 TSHIAME WWTW / 04 DOC PROC / 04 DRAW		



ISSUED FOR TENDER