

Questions and Answers TNPA/2026/05/0931/5219/RFP

Question 1

Could you confirm?

(b) Contractors must hold a valid refrigeration handling license issued by the South African Qualification and Certification Committee for Gas (SAQCC Gas).

c) Contractors must hold a valid refrigeration handling license issued by the South African Qualification and Certification Committee for Fire (SAQCC Fire).

The above Qualifications and certification on the functionality criteria are held by individually appointed employees not the contractor as an entity. If the submit the CV of the individual and valid SAQCC certification this should suffice?

Note that I spoke to both institutions (Gas/Fire) to confirm that all the above certifications are held as individuals and the reiterated that an entity cannot write an exam to get certified an individual employee can.

Answer

Correct, it must be held by and be valid (not expired, not waiting for registration or reactivation) by an individual, be it an employee (certified personnel) or a subcontractor of the tendering entity.

Question 2

Will this site be linked to the existing site? If yes, we would require information on the Babylon dongle number, CCTV server software, etc.

Answer

Yes - CCTV = NiceVision (Qognify) System (Version 3.2)

Babylon = XMP-Babylon System W3D Version 4.2

Question 3

Are there additional specs for the Access Control & CCTV Cameras

Answer

Yes- Technical Specifications for Access Control and CCTV Cameras will be provided (see attached annexure to the minutes)

Question 4

We would like to enquire about some functionality criteria on the above tender,

Is it mandatory for the bidding contractor to have SAQCC gas license and SAQCC fire license registered on the company name or can we use personnel certified by SAQCC?

Another option is to subcontract only if allowed, kindly advise.

Answer


See the response to question 1

Question 5

Could you please confirm if the generator area indicated below in the drawings and the extract below is indoor or open. it is not clear on the drawings.

Answer

The Genset is outdoor, on a plinth in an open, in unroofed portion of the service yard

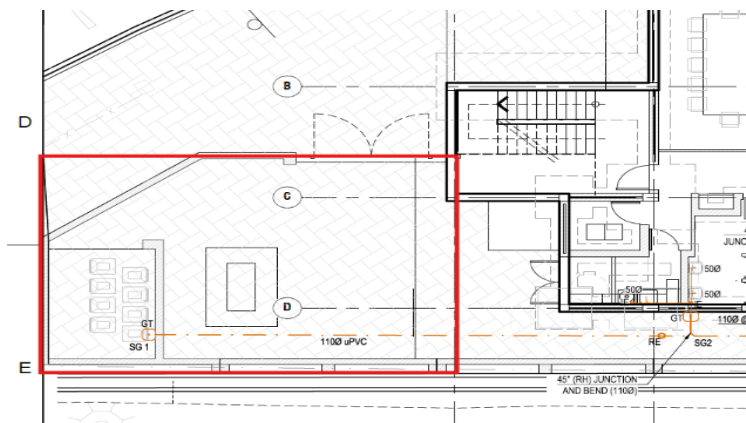

Question 6

Also, there is contradicting information between the generator spec and the BoQ. For example, the BoQ mentions a 200kVA unit, whereas the spec mentions a 500kVA.

Please review and advise.

Answer

Tenderers are requested to use the attached revised specification (Annexure A- to Addendum 1) for the supply, delivery, installation, testing, and commissioning of a 200 kVA outdoor diesel generator.

The changes are as follows:

On Page 90 of 149, please replace TPD-009-STANDBYPLANTSPEC (Annexure E), with the updated specification as per the attached (Annexure A- to Addendum 1). It is also mentioned on page 91 of 149 in paragraph 4.4.7.1 "The Diesel Generator shall be designed and constructed in compliance with Transnet Specification TPD-009-STANDBYPLANTSPEC Annexure E". The Tenderers need to refer to Annexure A- to Addendum 1 as per the attached addendum.

Question 7

We respectfully request that the closing date be extended by at least two (2) weeks. This additional time would enable us to prepare a market-competitive submission that thoroughly addresses all aspects of the tender and aligns with TNPA's requirements and expectations.

Answer

A 2-week extension has been granted, tenderers are to note that ***no further extension will be granted.*** An addendum of the closing date from **26 June 2026 @ 4pm** to **10 July 2026 @ 4pm** has been issued.