


SAFETY FENCE EARTHING

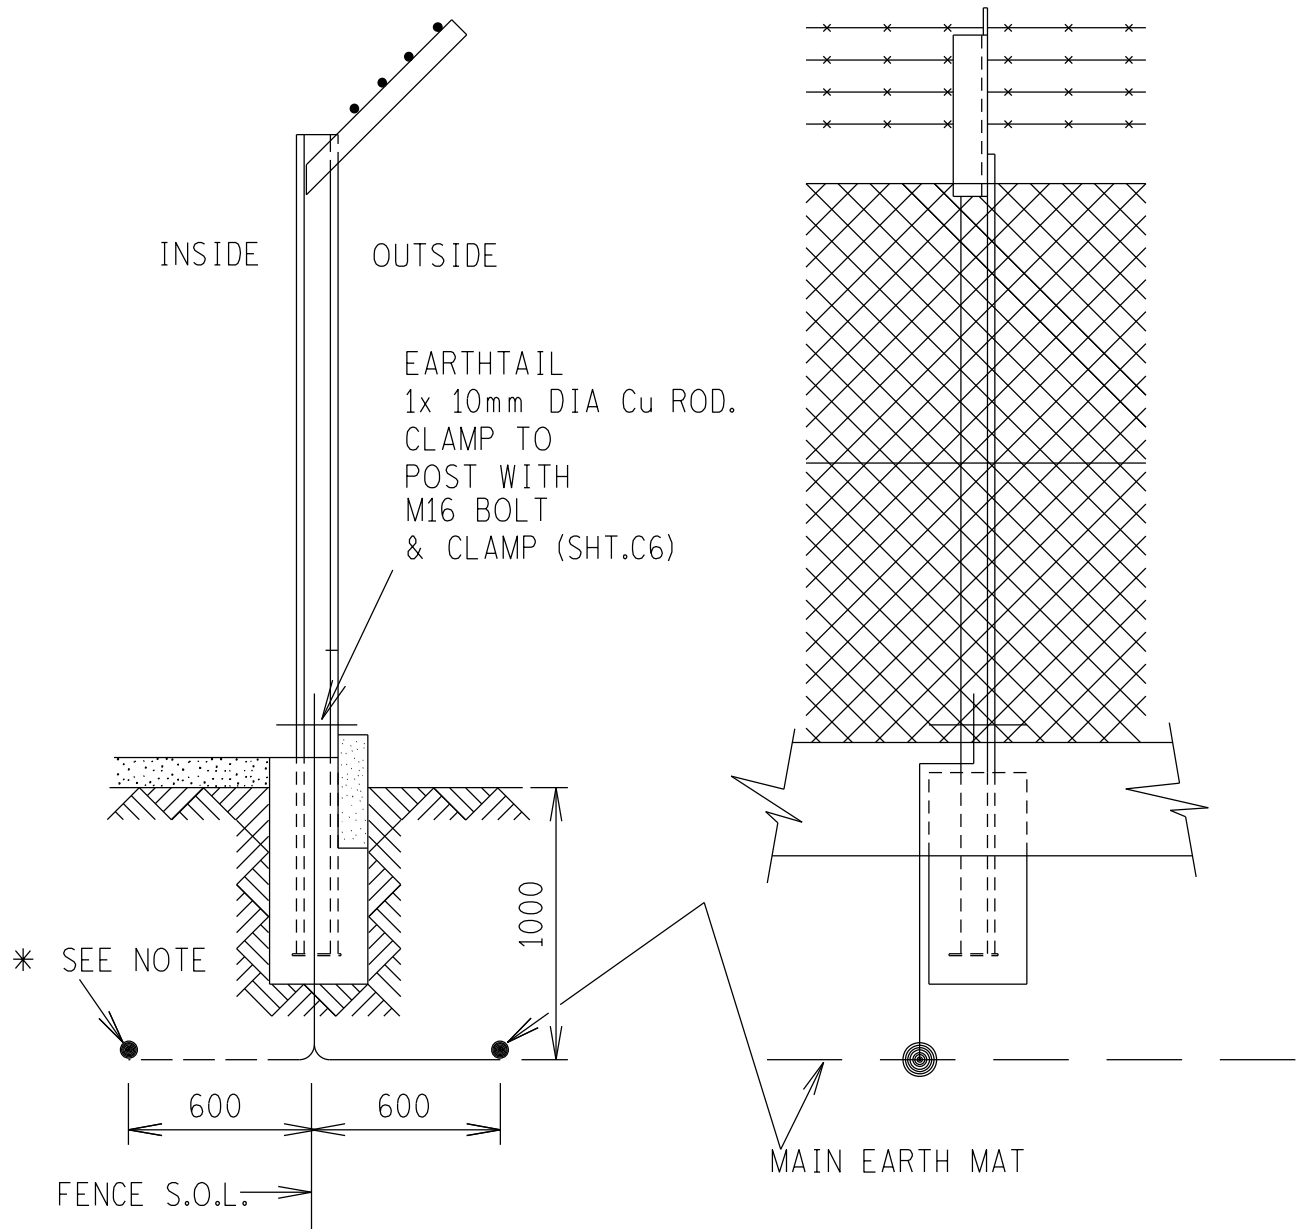


STEEL POSTS

FENCE TO BE EARTHED ON BOTH SIDES OF ANY GATE OR REMOVABLE PANEL AND AT INTERVALS NOT EXCEEDING 20000mm

* NOTE:- WHEN THE BARRIER SECURITY FENCE IS SITUATED ON THE SUBSTATION TERRACE THE MAIN EARTHMAT FINISHES 600mm ON THE INSIDE OF THE FENCE. REFER TO SHEET C3B.

THE C.A.D. REFERENCE NUMBER IS:
[100,164]00393EC13.R02



ESKOM

DRAWN
GETEKEN

CHKD
NAGES

AUTH
MAS

DvB
FEB 88

LER
FEB 88

REV

2

DATE
DATUM

16.4.
1997

EARTHING STANDARDS

0.54/393

SHEET C13

DRG. TEK
REGISTR

393C13.DGN