


* FOR NON-STANDARDS SEE NOTE 5

PLAN

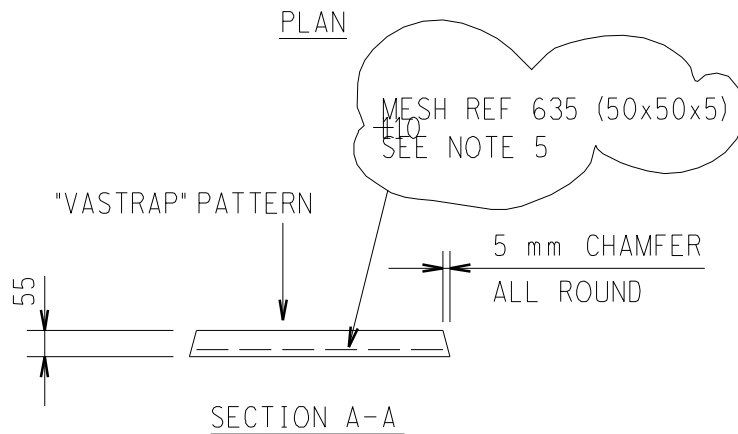

SECTION A-A

QUANTITIES:

MASS - 30kg

CONCRETE - 12,3l

MESH REF. 635 - 0,185m²

NOTES:

- 1 - CONCRETE GRADE 25/13
- 2 - CONCRETE COVER = 20mm
- 3 - REINFORCEMENT TO BE PLACED WITH MAIN STRANDS RUNNING IN LONGEST DIRECTION
- 4 - SLABS TO BE CAST IN STEEL MOULDS WITH SIDES CHAMFERED 5mm. TOP OF SLAB TO HAVE "VASTRAP" PATTERN
- 5 - FOR NON-STANDARD PANELS FROM 800 TO 1050 USE MESH REF 635 x 2 BOTTOM

PRE-CAST SLAB TRENCH COVER

THE C.A.D. REFERENCE NUMBER IS:
MUTSQ.54 00390K17A.P02

TRANSMISSION
SUBSTATION
TECHNOLOGY



ESKOM

DRAWN GETEKEN	DIEZ	12.6. 1985	CHKD NAGES	R.J.C.	12.6. 1985	AUTH MAS		17.07 2001	REV	4	DATE DATUM	15.09 1995
------------------	------	---------------	---------------	--------	---------------	-------------	--	---------------	-----	---	---------------	---------------

H.V. YARD CIVIL WORK
STANDARD DETAILS

0.54/390

SHEET 17A

DRG.TEK
REGISTR

390K17A.DGN A4L