


TYPICAL SECTION THRU' BRICK RETAINING WALL

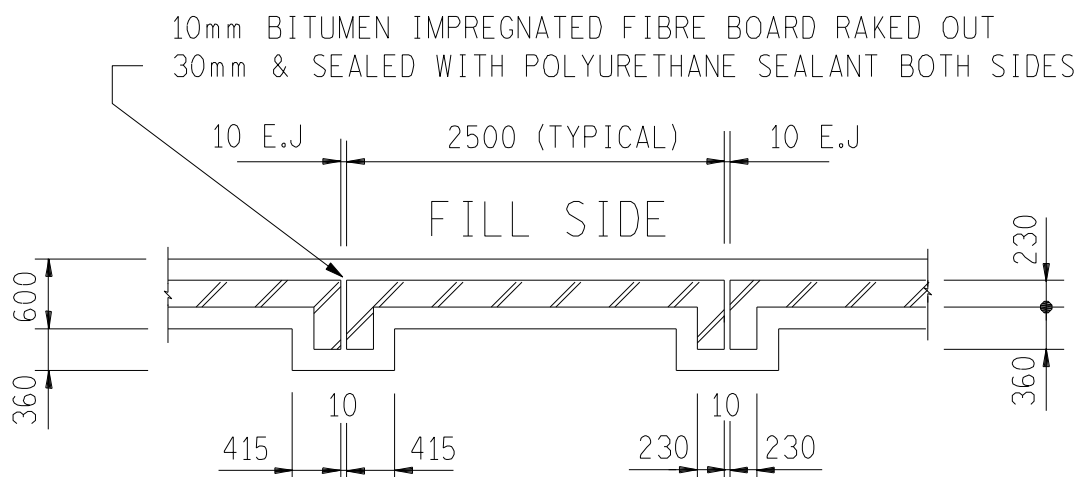

PLAN ON BRICK RETAINING WALL

NOTE:

TYPE OF BRICKS TO BE SPECIFIED ON LAYOUT DRAWING.
FACE BRICKS TO BE CLAY CLASS 'FBX' TO SABS 227 IN CLASS II MORTAR
PLASTER BRICKS TO BE CLASS 'NFP' IN CLASS II MORTAR WITH 15MM PLASTER
BRICKWORK TO BE REINFORCED WITH 150mm 'BRICKFORCE' REINFORCEMENT
EVERY COURSE

BRICK RETAINING WALL - 1,4m HIGH

TRANSMISSION
SUBSTATION
TECHNOLOGY
DEPARTMENT



ESKOM

DRAWN
GETEKEN

DJC.S

06.00

CHKD
NAGES

DB.N

06.00

AUTH
MAS

DJC.S

8.11.00

REV

0

DATE
DATUM

06.00

H. V. YARD CIVIL WORK
STANDARD DETAILS

0.54/390

SHEET 55B