


NOTE:

WITH EACH KIOSK THE CIVIL CONTRACTOR TO SUPPLY
2x50kg CHEMICAL POWDER
WHEELED FIRE EXTINGUISHERS

PLAN

CONCRETE TOPPING AT THICKNESSES SHOWN
WITH POWDERED WATERPROOFING ADMIXTURE
FOR MORTAR ADDED TO MANUFACTURERS SPEC.
SMOOTH STEEL TROWELED FINISH.

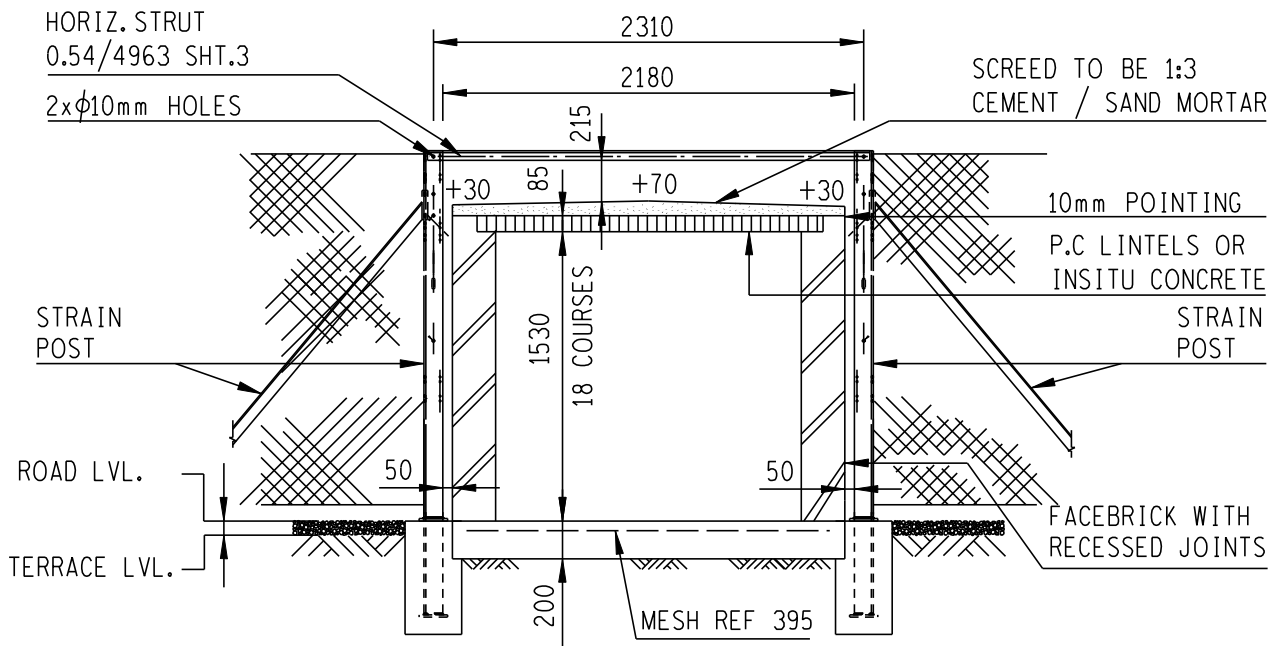

NOTES:

SECTION A-A

1. ALL WORK TO COMPLY WITH NBR - SABS 0400 AS WELL AS SABS 1200
2. BRICKWORK-FACEBRICK CLASS "FBX" TO SABS 227
3. CONCRETE STRENGTH TO BE 25/19 AT 28 DAYS

THE C.A.D. REFERENCE NUMBER IS :
MUTS0.54/00390K33.R05

TRANSMISSION
SUBSTATION
TECHNOLOGY
DEPARTMENT



ESKOM

DRAWN
GETEKEN

DB.N.

19/5/99

CHKD
NAGES

DJ.C.S

19/5/99

AUTH
MAS

D.S

10/09

REV

6

DATE
DATUM

09/09

FIRE EQUIPMENT KIOSK
H V YARD CIVIL WORK
STANDARD DETAILS

0.54/390

SHEET 56

DRG.TEK
REGISTR

A4L