


PLAN


1:50

CONCRETE TOPPING AT 30mm MIN. THICKNESSES
WITH COPROX WATERPROOFING ADMIXTURE
FOR MORTAR ADDED TO MANUFACTURERS SPEC.
SMOOTH STEEL TROWELED FINISH.
SLOPE TO BACK

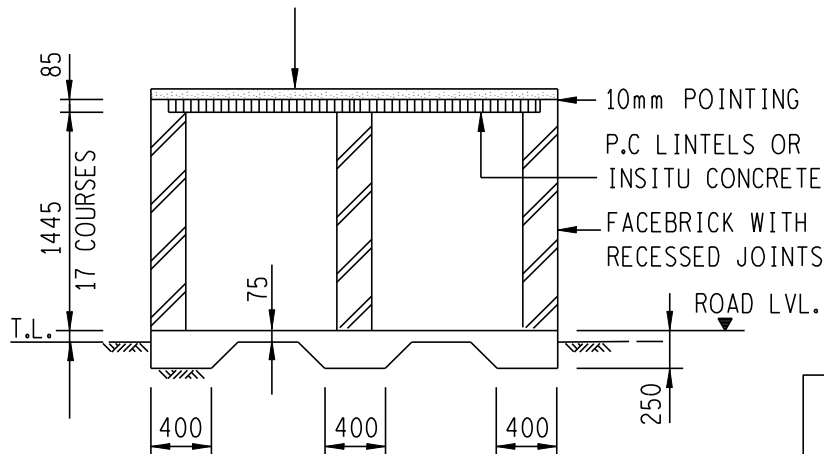

SECTION A-A

1:50

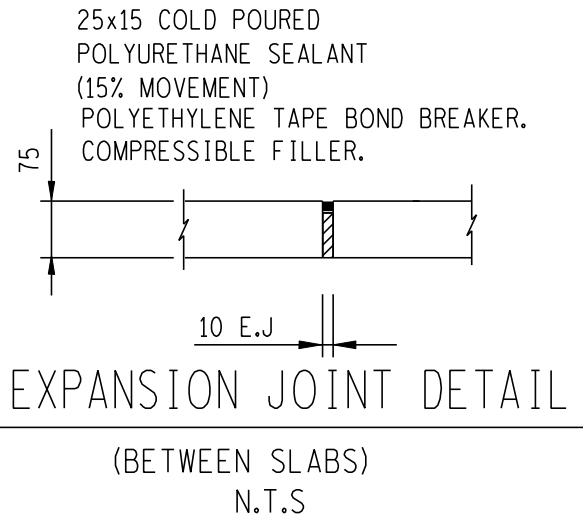

NOTES

1. ALL WORK TO COMPLY WITH NATIONAL BUILDING REGULATIONS - SABS 0400 AS WELL AS SABS 1200
2. BRICKWORK TO BE FACEBRICK CLASS "FBX" TO SABS 227 IN CLASS II MORTAR AS FOR BUILDINGS.
3. CONCRETE STRENGTH TO BE 10/19 AT 28 DAYS
4. SCREED TO BE 1:3 CEMENT / SAND MORTAR BY VOLUME.
5. FLOOR TO BE WOODFLOATED & TO FALL TO THE OUTSIDE
6. "6"+30" DENOTES THICKNESS OF SCREED.

NOTE

THE CONTRACTOR TO SUPPLY TWO 50kg DRY CHEMICAL POWDER FIRE EXTINGUISHER TROLLEY FOR EACH KIOSK TO ESKOM APPROVAL

TRANSMISSION
SUBSTATION
TECHNOLOGY
DEPARTMENT



ESKOM

DRAWN
GETEKEN

DBN

01/02/02

CHKD
NAGES

DBN

04/02/02

AUTH
MAS

DJS

04/02/02

REV

0

DATE
DATUM

2/02

H.V YARD CIVIL WORK
STANDARD DETAILS

0.54/390

SHEET 56 A

DRG. TEK
REGISTR

A4L