


The transformer shall be fitted with female type connector bushings. The male type connectors shall also be supplied by the transformer contractor, but installed by others on the medium voltage loop cables.

Notes:

The purpose of this drawing is to clarify the requirements of the associated contract/enquiry specification. The issue of this with the specification does not absolve the successful contractor from his normal responsibility to provide a satisfactory scheme **nor** to submit drawings of systems proposed for approval by the engineer.

The transformer shall be supplied with mating connectors. The connector arrangements shall be designed and positioned to allow the application of special tooling.

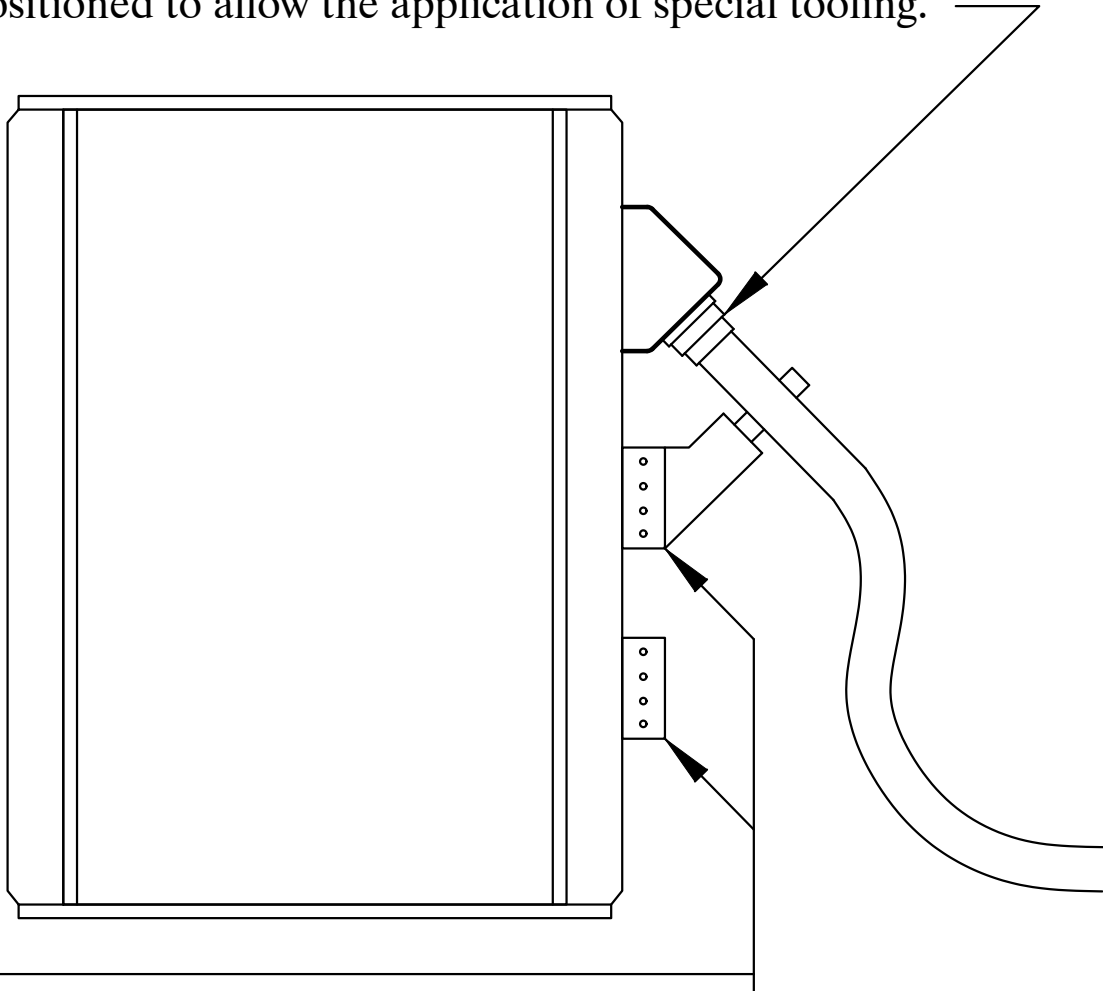

The transformer shall be fitted with mounting brackets to allow for the fitting of cable supports. Cable supports will be supplied by other.

DRAWN	AJRW				
DATE	06.08.2010		I REDRAWN	T W	06.08.2010
CHIEF DRAUGHTPERSON	T WATSON	REFERENCE DRAWINGS:	REVISIONS:	BY:	DATE:
PROTECTION ENGINEER		ETHEKWINI ELECTRICITY PROPOSED TRANSFORMER ARRANGEMENT TO ACCOMMODATE PLUGIN TYPE CONNECTOR FOR MEDIUM VOLTAGE			
PLANNING ENGINEER					
PROJECTS ENGINEER					
PLAN./PROJ. MANAGER					
APPROVED A. J. DOLD DEPUTY HEAD: H.V. OPERATIONS		SCALE: N.T.S.	DRAWING NUMBER: SP 673	REV: 1	